

## I/O Expansion

### Serial Bases

IOE-4404  
IOE-4422

### Expansion Modules

IOEX-4404  
IOEX-4422  
IOEX-4440

Covering Firmware 2.2.2

## User & Reference Manual



## Safety Information

The products described in this manual can fail in a variety of modes due to misuse, age, or malfunction and is not designed or intended for used in systems requiring fail-safe performance, including life safety systems. Systems with the products must be designed to prevent personal injury and property damage during product operation and in the event of product failure.

---



**Warning! Do not** remove or insert the Ethernet or diagnostics cable while circuit is live unless the area is known to be free of ignition concentrations of flammable gasses or vapors.

---

FreeWave Technologies, Inc. warrants the FreeWave® I/O Expansion (Product) that you have purchased against defects in materials and manufacturing for a period of two years from the date of shipment, depending on model number. In the event of a Product failure due to materials or workmanship, FreeWave will, at its discretion, repair or replace the Product. For evaluation of Warranty coverage, return the Product to FreeWave upon receiving a Return Material Authorization (RMA). The replacement product will remain under warranty for 90 days or the remainder of the original product warranty period, whichever is longer.

IN NO EVENT WILL FREEWAVE TECHNOLOGIES, INC., ITS SUPPLIERS, OR ITS LICENSORS BE LIABLE FOR ANY DAMAGES ARISING FROM THE USE OF OR INABILITY TO USE THIS PRODUCT. THIS INCLUDES BUSINESS INTERRUPTION, LOSS OF BUSINESS INFORMATION, INABILITY TO ACCESS OR SEND COMMUNICATION OR DATA, PERSONAL INJURY OR DAMAGE, OR OTHER LOSS WHICH MAY ARISE FROM THE USE OF THIS PRODUCT. THE WARRANTY IS EXCLUSIVE AND ALL OTHER WARRANTIES EXPRESS OR IMPLIED, INCLUDING BUT NOT LIMITED TO ANY WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR USE ARE EXPRESSLY DISCLAIMED.

FreeWave's Warranty does **not apply** in the following circumstances:

1. If Product repair, adjustments, or parts replacements are required due to accident, neglect, or undue physical, electrical, or electromagnetic stress.
2. If Product is used outside of FreeWave specifications as stated in the Product's data sheet.
3. If Product has been modified, repaired, or altered by Customer unless FreeWave specifically authorized such alterations in each instance in writing. Where applicable, this includes the addition of conformal coating.

FreeWave Technologies, Inc.  
5395 Pearl Parkway, Boulder, CO 80301  
303.381.9200  
Toll Free: 1.866.923.6168  
Fax: 303.786.9948

Copyright © 2019 by FreeWave Technologies, Inc.  
All rights reserved.

[www.freewave.com](http://www.freewave.com)

## Table Of Contents

<b>Preface</b> .....	<b>7</b>
<b>1. Overview</b> .....	<b>9</b>
1.1. Base Modules and Expansion Modules .....	10
<b>2. Connections</b> .....	<b>12</b>
2.1. Expansion Module Connectors .....	13
2.1.1. Expansion Module Data Connector .....	13
2.1.2. Expansion Module Diagnostics Connector .....	14
2.2. Serial Base Connectors .....	15
2.2.1. Serial Base Data Connector .....	15
2.2.2. Serial Base Diagnostics Connector .....	16
<b>3. Installation</b> .....	<b>17</b>
3.1. Power Connector - Serial Base 485 .....	18
3.2. Powering Serial Bases and Expansion Modules .....	19
<b>4. Set Up and Programming</b> .....	<b>20</b>
4.1. Reading Serial Bases and Expansion Modules in Tool Suite .....	21
4.2. Defining Channel Settings in Tool Suite .....	23
4.3. Upgrade Serial Bases and Expansion Modules to the Latest Firmware .....	26
4.4. Programming Stack Settings in Tool Suite .....	28
4.5. Settings That Apply to the Entire Stack .....	30
4.5.1. Serial Port Communication between the Computer and Stack .....	30
4.5.2. Communication Timeout Settings and Required Stack Power .....	31
4.5.3. Communication and Message Characteristics of Modbus .....	31
<b>5. Channel Functions and Specifications</b> .....	<b>33</b>
5.1. IOE-4440 and IOEX-4440 Channels .....	34
5.2. IOE-4422 and IOEX-4422 Channels .....	34
5.3. IOE-4404 and IOEX-4404 Channels .....	34
<b>6. Universal Configurable Channels</b> .....	<b>36</b>
6.1. Digital Input - Universal Channel .....	37
6.1.1. Universal Digital Input Configuration .....	37
6.1.2. Digital Input Registers NOT in Tool Suite .....	38
6.1.3. Universal Channel Configured as a Digital Input .....	38
6.2. Digital Output - Universal Channel .....	39
6.2.1. Universal Digital Output Configuration .....	40
6.2.2. Tool Suite Serial Base Stack Settings .....	41
6.2.3. Digital Output Registers NOT in Tool Suite .....	41
6.2.4. Universal Channel Configured as an Digital Output .....	42
6.3. Analog Input - Universal Channel .....	42

6.3.1. Universal Analog Input Configuration .....	43
6.3.2. Tool Suite Serial Base Stack Settings .....	45
6.3.3. Universal Channel Configured as an Analog Input .....	45
6.4. Analog Output - Universal Channel .....	47
6.4.1. Universal Analog Output Configuration .....	47
6.4.2. Universal Channel Configured as an Analog Output .....	49
6.5. Sensor Power - Universal Channel .....	49
6.5.1. Universal Sensor Power Channel Configuration .....	50
6.5.2. Universal Channel Configured a Sensor Power .....	50
<b>7. Input-Only Channels .....</b>	<b>51</b>
7.1. Digital Input - Input-Only Channel .....	52
7.1.1. Input-Only Channel Digital Input Configuration .....	52
7.1.2. Digital Input Registers NOT in Tool Suite .....	54
7.1.3. Input-only Channel Configured as an Digital Input .....	54
7.2. Analog Input - Input-Only Channel .....	55
7.2.1. Input-Only Analog Input Configuration Settings .....	55
7.2.2. Tool Suite Serial Base Stack Settings .....	57
7.2.3. Input-only Channel Configured as an Analog Input .....	58
<b>8. Electrically Isolated Channels .....</b>	<b>59</b>
8.1. Digital Output - Isolated Channel .....	60
8.1.1. Isolated Digital Output Configuration .....	60
8.1.2. Tool Suite Serial Base Stack Settings .....	61
8.1.3. Digital Output Registers NOT in Tool Suite .....	61
8.1.4. Isolated Channel Configured as an Digital Output .....	62
8.2. Digital Input - Isolated Channel .....	62
8.2.1. Isolated Digital Input Configuration .....	63
8.2.2. Digital Input Registers NOT in Tool Suite .....	64
8.2.3. Isolated Channel Configured as an Digital Input .....	64
<b>9. Quick Reference Modbus Register Map .....</b>	<b>65</b>
<b>10. Modbus Register Map .....</b>	<b>66</b>
10.1. Holding Coils (Read / Write Commands) .....	67
10.2. Discrete Inputs (Read-Only Commands) .....	71
10.3. Input Registers (Read-Only Commands) .....	72
10.4. Holding Registers (Read / Write Commands) .....	73
10.5. Modbus Timing .....	77
10.5.1. Modbus Command Response Time by Device and Command Type .....	77
10.5.2. Modbus Output Execution Delay Time by Device and I/O Type .....	78
<b>11. Modbus Register Descriptions .....</b>	<b>79</b>
11.1. Holding Coils (Read / Write) Descriptions .....	80

11.1.1. 0 to 11: DO, Sensor Power ON .....	80
11.1.2. 24 to 35: Apply Default DO, AO, Sensor Power .....	80
11.1.3. 48 to 59: Default DO, Sensor Power State .....	81
11.1.4. 64 to 71: Clear Counter on Read .....	81
11.1.5. 72 to 83: DI Counter Clear .....	81
11.1.6. 92 to 95: High-Speed DI Counter on Isolated .....	81
11.1.7. 96 to 106: DI Counter Falling Edge Increment .....	82
11.1.8. 112 to 119: AI Signed Integer Result .....	82
11.1.9. 120 to 127: AI, AO Current, Voltage Mode .....	82
11.1.10. 136 to 147: DI Counter Latch .....	83
11.1.11. 152 to 163: Pulse Counter De-Bounce .....	83
11.2. Discrete Inputs (Read-Only) Descriptions .....	83
11.2.1. 10000 to 10011: DI State .....	83
11.2.2. 10024 to 10035: Circuitry Protection Active .....	83
11.3. Input Registers (Read-Only) Descriptions .....	83
11.3.1. 30000 to 30016: AI Integer Result .....	83
11.3.2. 30032 to 30047: AI Result, Floating Point .....	84
11.3.3. 30064 to 30087: DI Counter .....	84
11.3.4. 30096: Modbus Request Counter .....	85
11.3.5. 30112 to 30119: DO Current .....	85
11.3.6. 30152: Device Temperature .....	85
11.3.7. 30153: VBATT .....	85
11.4. Holding Registers (Read / Write) Descriptions .....	85
11.4.1. 40000 to 40003: AO Command .....	85
11.4.2. 40008 to 40011: Default AO Command .....	86
11.4.3. 40016 to 40027: Channel Mode .....	86
11.4.4. 40040 to 40047: AI Filter Setting .....	86
11.4.5. 40056 to 40063: Resistor Pull Setting .....	86
11.4.6. 40072 to 40075: AO Resolution .....	87
11.4.7. 40080 to 40091: DO Monostable Timeout .....	87
11.4.8. 40096 to 40103: AI Zero Voltage .....	87
11.4.9. 40104 to 40111: AI Voltage Span .....	88
11.4.10. 40112 to 40119: AI, AO Zero Current .....	88
11.4.11. 40120 to 40127: AI, AO Current Span .....	89
11.4.12. 40128: Comm Connection .....	90
11.4.13. 40129: Comm Timeout Latch .....	90
11.4.14. 40130: Comm Port Baud Rate .....	90
11.4.15. 40131: Comm Port Parity .....	90
11.4.16. 40132: Comm Port Stop Bits .....	91

11.4.17. 40133: Modbus Min Transmit Inter-Message Interval .....	91
11.4.18. 40134: RS-485 Turn-On Delay .....	91
11.4.19. 40135: RS-485 Turn-Off Delay .....	91
<b>12. Release Notes .....</b>	<b>92</b>
<b>13. Expansion Module Dimensions .....</b>	<b>94</b>
<b>14. Serial Base Dimensions .....</b>	<b>95</b>
<b>Appendix A: Technical Specifications .....</b>	<b>96</b>
General Information .....	96
Digital Input .....	97
Digital Output .....	97
Analog Input .....	97
Analog Output .....	97
Sensor Power .....	98
Part Number Summary .....	98
<b>Appendix B: I/O Device LEDs .....</b>	<b>99</b>
Expansion Module LEDs .....	100
Serial Base LEDs .....	100
<b>Appendix C: FreeWave Legal Information .....</b>	<b>101</b>

## Preface

---

This document includes this information about the FreeWave I/O Expansion products:

- A basic introduction to the Serial Bases and Expansion Modules that make up the I/O product line.
- Descriptions of each port and LED on Serial Bases and Expansion Modules.
- A description of the parameters required for each channel.
- Steps to setting up and programming a stack of Expansion Modules using Tool Suite.
- Pin out and mechanical drawings.
- Modbus register map details.

**Note:** For information about the firmware releases that apply to the I/O Expansion products, see [Firmware Updates](#).

## Assumptions

- The contents of this manual assumes familiarity with the Modbus protocol.
- For more information about the protocol, see [www.modbus.org/specs.php](http://www.modbus.org/specs.php).
- The term "radio" and "transceiver" are used throughout this manual to refer to the described devices.

## Additional Information

**Note:** Use the [support.freewave.com](http://support.freewave.com) website to download the latest documentation for the I/O Expansion.  
Registration is required to use this website.

## Contact FreeWave Technical Support

For up-to-date troubleshooting information, check the **Support** page at [www.freewave.com](http://www.freewave.com).

FreeWave provides technical support Monday through Friday, 8:00 AM to 5:00 PM Mountain Time (GMT -7).

- Call toll-free at 1.866.923.6168.
- In Colorado, call 303.381.9200.
- Contact us through e-mail at [support@freewave.com](mailto:support@freewave.com).

## Document Styles

This document uses these styles:

- Products and applications appear as: **FreeWave**.
- Parameter setting text appears as: **[Page=radioSettings]**
- File names appear as: **configuration.cfg**.
- File paths appear as: **C:\Program Files (x86)\FreeWave Technologies**.
- User-entered text appears as: **xxxxxxxxxx**.



**Caution:** Indicates a situation that **MAY** cause damage to personnel, the radio, data, or network.

**Example:** Provides example information of the related text.

**FREEWAVE Recommends:** Identifies FreeWave recommendation information.

**Important!:** Provides crucial information relevant to the text or procedure.

**Note:** Emphasis of specific information relevant to the text or procedure.



**Tip** Provides time saving or informative suggestions about using the product.



**Warning!** Indicates a situation that **WILL** cause damage to personnel, the radio, data, or network.

## 1. Overview

---

The I/O Expansion product family provides expandable digital input, digital output, analog input, and analog output capabilities for any device with a Modbus controller. Expandable I/O can be added directly to PLCs, RTUs, and SCADA hosts. I/O Expansion can also integrate into new and existing wireless communication systems such as proprietary, licensed and unlicensed, cellular and satellite radio systems.

The I/O Expansion Module may either be stacked on an applicable I/O base or can serve as expandable I/O modules through a serial connection. Regardless of the configuration, up to 15 modules can be stacked on a single Radio Base or Serial Base, providing up to 192 I/O points, including those on the Base Module.

This example image of an I/O Expansion stack shows an FGR2-IO-IOE as the Base Module.



Figure 1: Example of an I/O Expansion stack

## 1.1. Base Modules and Expansion Modules

The bottom unit in a stack of I/O Expansion Modules is referred to as the Base Module and provides communication to the outside world. The Base Module in a stack can be one of the following:

- **Radio Base** - A Radio Base provides expandable, **wireless** I/O and can be polled and controlled wirelessly across FreeWave's wireless serial network.
  - The FGR2-IO-IOE radio is the only Radio Base device available.

**Note:** For information about the FGR2-IO-IOE, see the **LUM0008AG 900 MHz Wire Replacement IO User Manual** available from [support.freewave.com](http://support.freewave.com). This document does NOT provide reference information for the FGR2-IO-IOE.

- **Serial Base** - A Serial Base provides expandable, **wired** I/O to any device with RS232, RS422, and RS485 data communication interfaces. Serial Bases come in these models:
  - IOE-4404
  - IOE-4422
  - IOE-4440
- **Expansion Modules** - These can be added to a Radio Base or Serial Base device to expand the number of I/O channels available.

- Expansion Modules on their own do not communicate; they must be connected to a Radio Base or a Serial Base.
- The available expansion modules are.
  - IOEX-4404
  - IOEX-4422
  - IOEX-4440

**Note:** The X in the model number indicates that the model is an expansion module.

Different isolated channels are available depending on the model number.

**Note:** For more information see [Channel Functions and Specifications \(on page 33\)](#).


## 2. Connections

---

- [Expansion Module Connectors \(on page 13\)](#)
- [Serial Base Connectors \(on page 15\)](#)

## 2.1. Expansion Module Connectors

These sections describe each connector on an I/O Expansion Module. For information about the I/O channels available on the Expansion Modules, see [Channel Functions and Specifications \(on page 33\)](#).

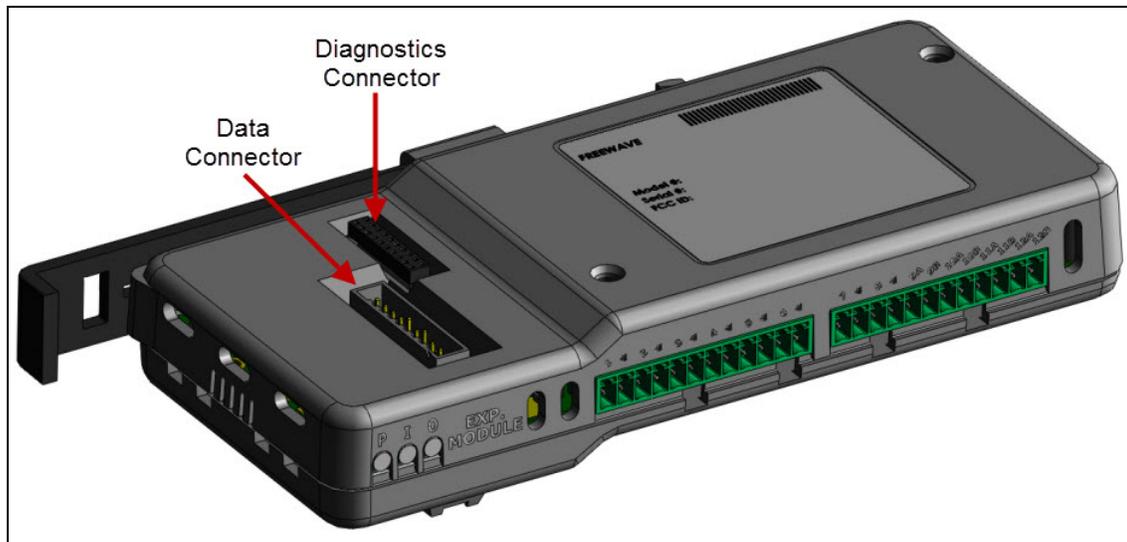

**Figure 2: Expansion Module Connectors**

### 2.1.1. Expansion Module Data Connector

The 10-pin data connector passes data directly through to the Serial Base or Radio Base.

**Note:** For more information, see [Serial Base Data Connector \(on page 15\)](#) or the documentation for the Radio Base for detailed descriptions.

- The data connector on the top Expansion Module can be used to provide power to all devices in the stack.
- Connecting power to the 10-pin data connector on the top module delivers the supply voltage to all modules in the stack.

This pin-out table summarizes the function of each pin:

Expansion Module Data Connector		
Pin	Pin Title	Description
1	VBAT	Power
2	Interrupt	Interrupt used to place the Base into Setup Mode
3	DTR	Data Terminal Ready input of Serial Base
4	Ground	Ground

Expansion Module Data Connector		
Pin	Pin Title	Description
5	TXD	Transmit data output of the Serial Base or Radio Base. Y+ data of RS485 output.
6	Ground	Ground
7	RXD	Receive data input of the Serial Base or Radio Base. A+ data of RS485 input.
8	DCD	Carrier Detect output of Radio Base
9	RTS	B- data of RS485 input
10	CTS	Z- data of RS485 input


### 2.1.2. Expansion Module Diagnostics Connector

The 20-pin diagnostic connector provides board-to-board communication for stacked Expansion Modules, and can be used for programming. It does not serve any diagnostic function.

## 2.2. Serial Base Connectors

These sections describe each connector on a Serial Base and the pin layout of each.

**Note:** For information about the I/O channels available on the Serial Base, see [Channel Functions and Specifications \(on page 33\)](#).

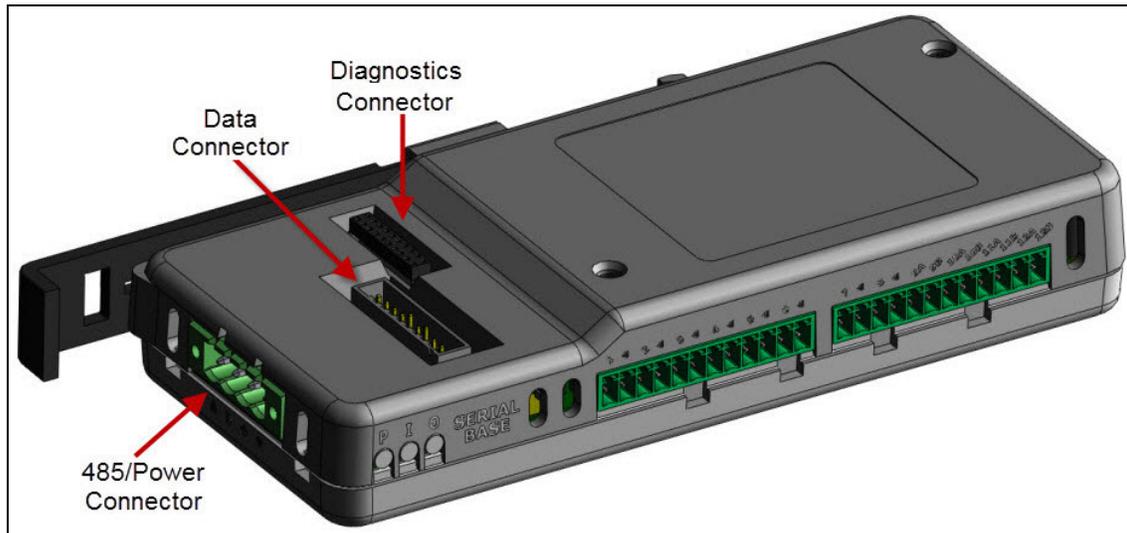

**Figure 3: Serial Base Connectors**

### 2.2.1. Serial Base Data Connector

This 10-pin connector provides serial communication and power to the Serial Base and supports RS232, RS422, and RS485 serial communication interfaces.


- When Expansion Modules are connected to the Serial Base, power is provided to the Expansion Modules through the power and ground pins on this connector.
- If the Expansion Modules have a Serial Base, power can alternatively be supplied by the serial 485/Power Connector described in [Power Connector - Serial Base 485 \(on page 18\)](#).

This pin-out table summarizes the function of each pin in the 10-pin data connector:

Serial Base Data Connector		
Pin	Pin Title	Description
1	VBAT	Power
2	Interrupt	Interrupt used to place the Base into Setup Mode
3	DTR	Data Terminal Ready
4	Ground	Ground
5	TXD	Transmit Data
6	Ground	Ground

Serial Base Data Connector		
Pin	Pin Title	Description
7	RXD	Receive Data
8	DCD	Carrier Detect
9	RTS	Request to Send
10	CTS	Clear to Send

**Note:** Pin 1 is the closest pin to the edge of device.

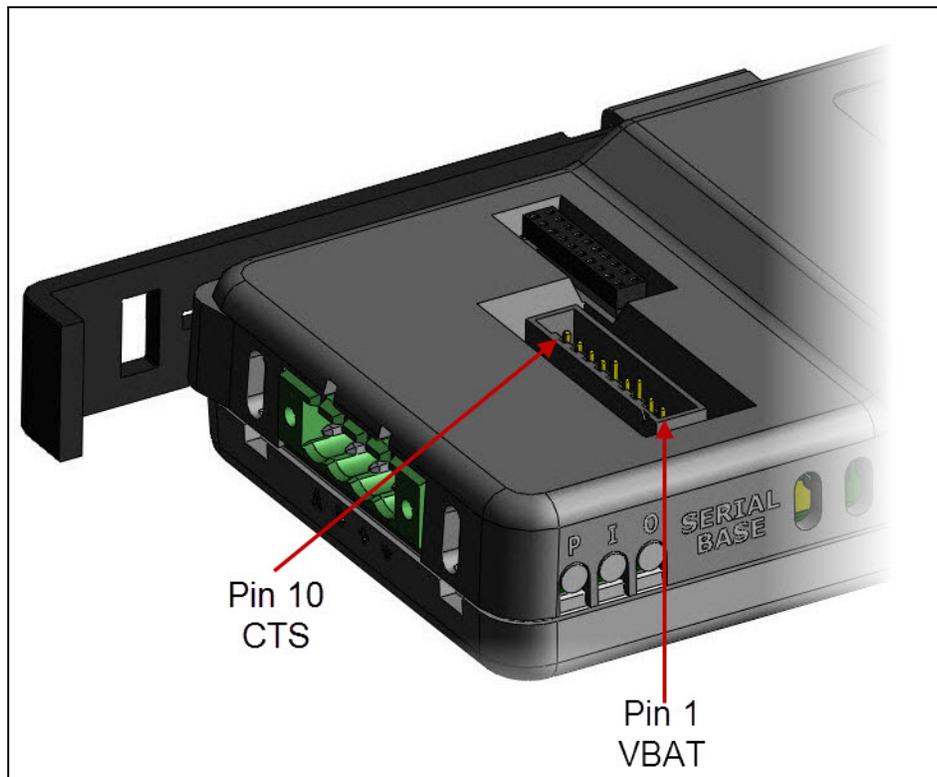

**Figure 4: Serial Base Connector**

### 2.2.2. Serial Base Diagnostics Connector

This 20-pin connector provides configuration access to the Serial Base with the **Tool Suite** configuration software without removing either the Data Connector or 485/Power connector.

The 20-pin connector on an attached Expansion Module passes data and settings directly to and from the base module (Serial Base or Radio Base).

## 3. Installation

---

- [Power Connector - Serial Base 485 \(on page 18\)](#)
- [Powering Serial Bases and Expansion Modules \(on page 19\)](#)

### 3.1. Power Connector - Serial Base 485


This 4-pin connector provides serial communication and power to the Serial Base and any attached Expansion Modules.

- The serial communication interface is limited to two-wire 485 when a shorting connector is placed on the 10-pin connector on top of the device.
- The shorting connector shorts pins 5 (TXD) to 7 (RXD) for Bus + and pins 9 (RTS) and 10 (CTS) for Bus -.

This table summarizes the function of each pin:

Pin	Description
B	Bus – for two-wire 485 half duplex with shorting connector
A	Bus + for two-wire 485 half duplex with shorting connector
VBAT	Power
Ground	Ground

Figure 5 shows the pin orientation:

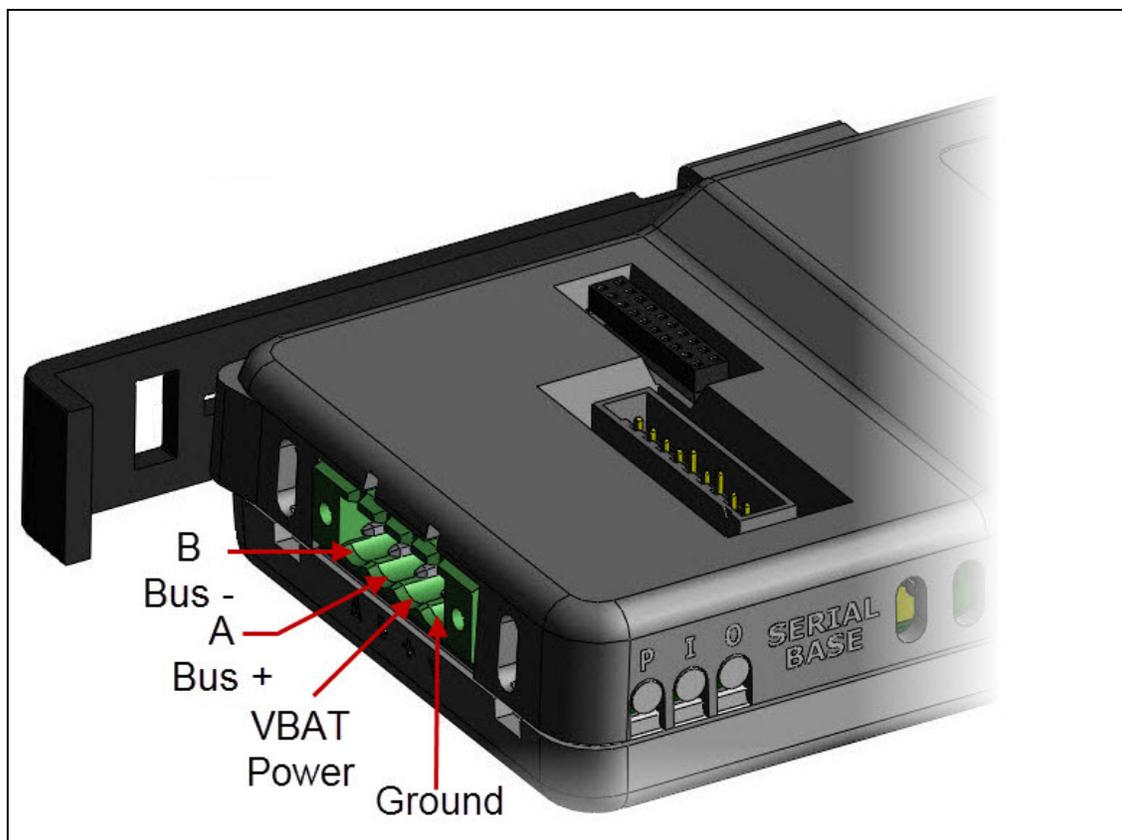

**Figure 5: Power Connector - Serial Base 485**

## 3.2. Powering Serial Bases and Expansion Modules

Power is shared between all devices in a stack of Expansion Modules. When one device in the stack is powered (Expansion Module, Serial Base, or Radio Base) then all connected devices are powered.

A stack of Expansion Modules can be powered through one of these options:

- Data Connector on the top Expansion Module.
  - See [Expansion Module Data Connector \(on page 13\)](#).
- 485/Power Connector on a Serial Base.
  - See [Power Connector - Serial Base 485 \(on page 18\)](#).
- I/O Connector on a Radio Base.
  - See the Wire Replacement I/O User Manual (FreeWave Part Number: LUM0008AC) for details about powering the FGR2-IO-IOE.

Power supply voltage limits for all Serial Base and Expansion Modules are:

Item	Min	Typical	Max	Units
Power Supply Voltage	7.5	-	30	V

This table provides the current consumption for a sample Serial Base and Expansion Module configuration:

Channel Configuration			Current Consumption at 12 V (in mA)
Universal Channels	Input-Only Channels	Isolated Channels	12 V
Disabled	Disabled	Disabled	17.0
DO: Off	Disabled	DO: Off	17.0
DO: On	Disabled	DO: On	18.1
DI	DI	DI	17.0
AO: 0 mA	Disabled	Disabled	18.2
AO: 20 mA	Disabled	Disabled	98.2
AI: Voltage	AI: Voltage	Disabled	17.0
AI: Current	AI: Current	Disabled	25.0

## 4. Set Up and Programming

---

Setup and program Serial Bases and Expansion Modules using the Modbus registers or using the configuration tools provided in **Tool Suite**.

In **Tool Suite**:

- Use the **Configuration** application to define the settings for the most common parameters for both the Serial Bases and their Expansion Modules in the network.
- Use the **Modbus Interface** application to validate and troubleshoot the Modbus configuration of the devices in the stack.

**Note:** **Tool Suite** is available for download from [support.freewave.com](http://support.freewave.com).

- [Reading Serial Bases and Expansion Modules in Tool Suite \(on page 21\)](#)
- [Defining Channel Settings in Tool Suite \(on page 23\)](#)
- [Upgrade Serial Bases and Expansion Modules to the Latest Firmware \(on page 26\)](#)
- [Programming Stack Settings in Tool Suite \(on page 28\)](#)
  - [Settings That Apply to the Entire Stack \(on page 30\)](#)

## 4.1. Reading Serial Bases and Expansion Modules in Tool Suite

Use **Tool Suite** to

- Connect a stack of I/O devices.
- Read and program all the devices in the stack by connecting to the last Expansion Module in the stack.

**Tool Suite** reads the device settings starting from the Serial Base or Radio Base and for each Expansion Module in the stack.

To read and program a Serial Base and Expansion Modules using **Tool Suite**, connect the last device in the stack to a computer with **Tool Suite** installed.

**Important!** If using IOEX-4422PC or IOEX-4422P (previous versions of the I/O Expansion products), update an IOE-4422 or IOEX-4422 model respectively, using the settings read from the older models.

### Procedure

1. Connect a serial or diagnostic cable between the computer and the device.

**FREEWAVE Recommends:** Using a diagnostic cable is recommended. If information is needed to identify the ports, see [Expansion Module Data Connector \(on page 13\)](#) and [Expansion Module Diagnostics Connector \(on page 14\)](#).


2. Connect the power supply to the radio and the power source to turn on the device.

**Note:** If connected to the device with the serial cable, go to Step 3.  
If connected to the device with the diagnostic cable, the radio enters Setup mode automatically. Go to Step 4.

3. If using the serial cable (FreeWave Part Number: ASC3610DJ), or are using a board-level device, press the button on the serial cable or short pins 2 & 4 (Brown to Black) on the white 10 pin header connected to the data port.


**Note:** When in Setup mode, the three LEDs on a Serial Base show Blinking Green  continuously.  
When a Radio Base is in Setup mode, the three LEDs on the Radio Base show Solid Green .

4. In Tool Suite, click **Configuration** in the **Applications** pane. ([Figure 6](#))  
The **Configuration** window opens.

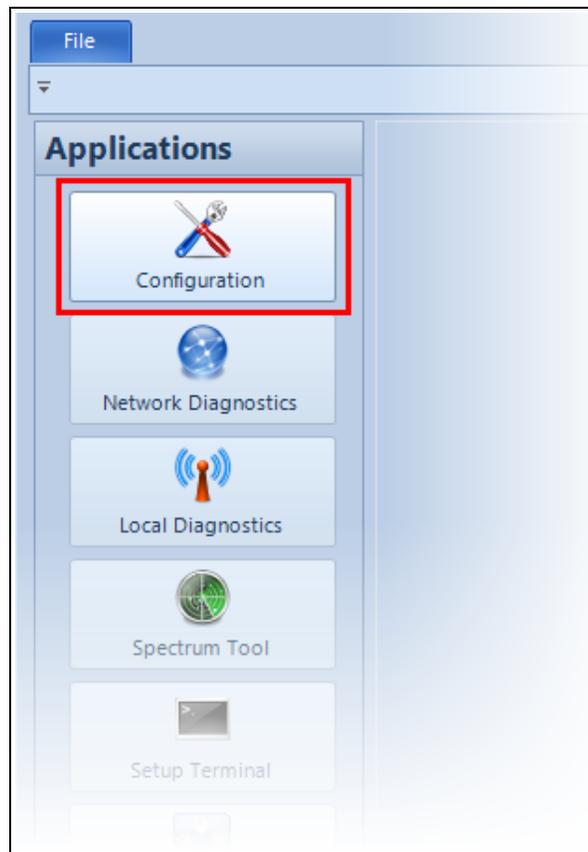

**Figure 6: Configuration button**

5. If using a Serial Base, click **Read Serial Base** in the **Configuration** (Figure 7) ribbon to read the current settings for each device in the stack.  
If using a Radio Base, click **Read Radio**.

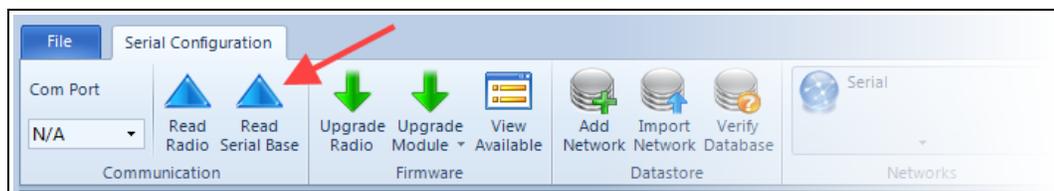

**Figure 7: Tool Suite Configuration ribbon**

**Tool Suite** reads the stack starting with the base and reads each Expansion Module starting with the one connected directly to the base.

## 4.2. Defining Channel Settings in Tool Suite

Each Serial Base and Expansion Module comes with 12 channels.

**Note:** The channels are described in [Channel Functions and Specifications](#) (on page 33).


Use **Tool Suite** to set whether a channel is:

- a Digital Input or Digital Output
- an Analog Input or Analog Output
- a Sensor Power

**Important!** If a channel is changed to a different function, (e.g., change a Universal Channel from Digital Input to Analog Input) wait 2 seconds for reliable readings from the channel.

### Procedure

1. In Tool Suite, click **Configuration** in the **Applications** pane. (Figure 8)  
The **Configuration** window opens.

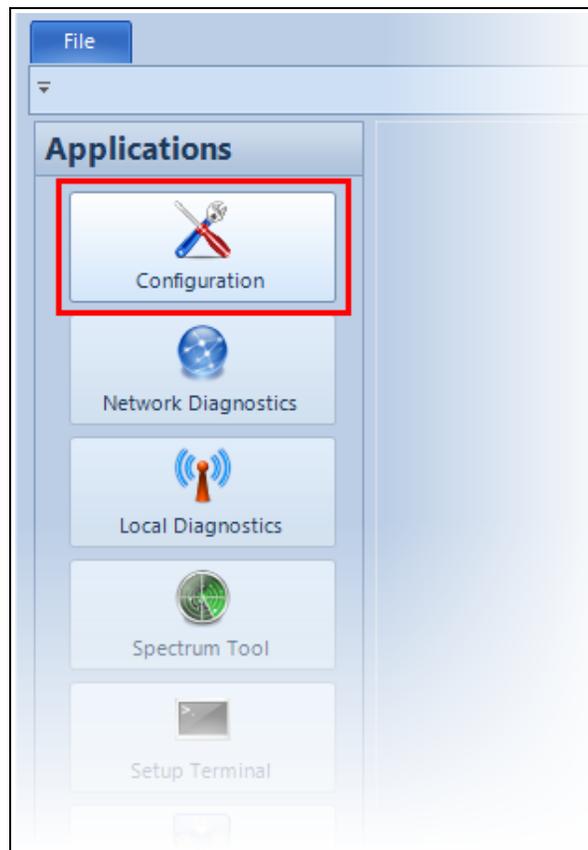

**Figure 8: Configuration button**

2. In the **Networks** section of the **Configuration** ribbon, select the network the I/O devices reside in.

**Note:** For information about adding networks, see the Tool Suite **User Manual**.

3. Create a template to load to a device at a later time:
  - a. Click **Template Devices** at the bottom of the **Device** tree.
  - b. Right-click anywhere in the **Device** tree and select **Add > Serial Base Template** to add a Serial Base.
  - c. Name the device.
  - d. Select the module type and click **Add**.

**Note:** When programming a device directly, see the [Reading Serial Bases and Expansion Modules in Tool Suite \(on page 21\)](#) to load the current device settings. The device stack is shown in the **Template Devices** tab.

4. Add an Expansion Module:
  - a. Add a Serial Base.
  - b. Right-click the Serial Base in the **Device** tree and select **Add Expansion Module**.
  - c. Name the device.
  - d. Select the module type and click **Add**.
5. In the **Device** tree, select the device to configure.  
The current settings appear in the right pane and are grouped by channel type.



**Figure 9: (0) Universal Channels in the IO Tool Suite tabs**

**Note:** If setting a Serial Base, set the settings that apply to the entire stack. For more information, see [Settings That Apply to the Entire Stack \(on page 30\)](#).

6. Click the tab that contains the channel to configure:
  - Universal Channels - Channels 1 to 4
  - Input-Only Channels - Channels 5 to 8
  - Isolated Channels - Channels 9 to 12
7. In the **I/O Mode** field for the channel to configure, select the channel function (e.g., Digital Output).
  - If not using a channel on a device, select **Disabled** to indicate that the channel is not in use.
  - The other fields that apply to the selected channel function appear when the channel function is selected.

**Note:** For information about each parameter setting, see the descriptions of each channel type in [Channel Functions and Specifications \(on page 33\)](#).

- Changes are saved to the Tool Suite database as they are made.

8. Send the configurations to a device by:
  - a. Send only the changed parameters to a single device in the stack:

**Important!** This option is only available if **Read Serial Base** is selected and are NOT sending parameter settings from a template to the device.

- i. Select the device in the **Configuration** application.
    - ii. Click **Quick** in the **Device Title** ribbon.
  - b. Send all the settings for all parameters:
    - i. Select the device in the **Configuration** application.
    - ii. Click **All** in the **Device Title** ribbon.
  - c. Set a device back to its factory default settings:
    - i. Select the device in the **Configuration** application.
    - ii. Click **Default** in the **Device Title** ribbon.
  - d. Send changes to all the devices in a stack at one time:
    - i. Right-click the base in the **Devices** tree in the Configuration application.
    - ii. Select **Program Stack**.

### 4.3. Upgrade Serial Bases and Expansion Modules to the Latest Firmware

If **Tool Suite** is connected to a device, and a new version of firmware is available for that model, an indication appears in the **Configuration** application's **Device Information** tab.

#### Procedure

1. Verify the device is connected to **Tool Suite** and in **Setup** mode.
2. In Tool Suite, click **Configuration** in the **Applications** pane. (Figure 10)  
The **Configuration** window opens.

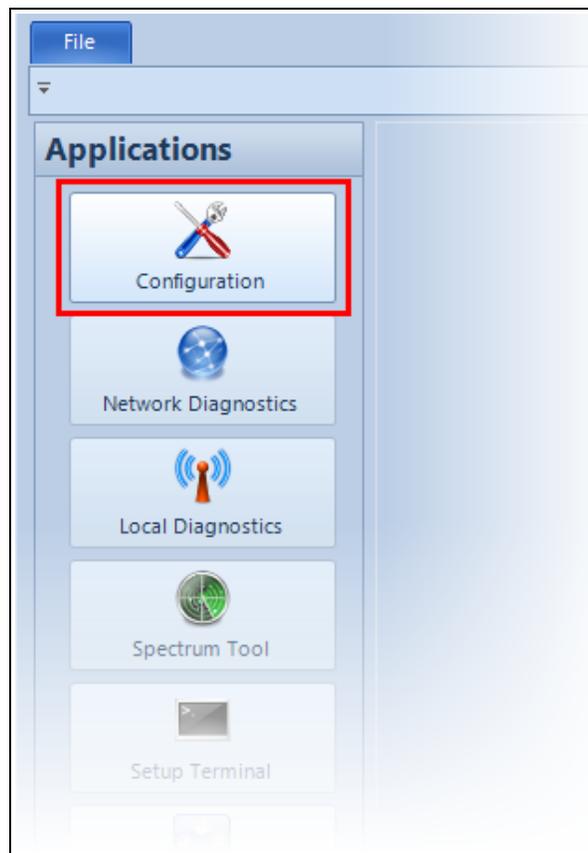


Figure 10: Configuration button

3. Click **Read Serial Base** to read the latest settings and configurations from the Serial Base and all the Expansion Modules in the stack. (Figure 11)



Figure 11: Tool Suite Configuration ribbon

4. In the **Devices** tree, select the device to upgrade.
5. Click **Upgrade Module** in the **Firmware** section of the **Configuration** ribbon.
6. Click **Yes** at the prompt to continue.

**Tool Suite** identifies the firmware version loaded on the connected device and shows the latest version of firmware available for that model.

7. Click **Yes** to continue with the upgrade.

The system shows the progress of the firmware upgrade in **Tool Suite**. When the upgrade is completed, a message appears that the firmware upgrade was successful.

**Note:** While the device's firmware is being updated, each LED displays solid red .




**Warning!** Do NOT disconnect the stack from **Tool Suite** or from power while the firmware is updating. If the connection or power is lost during the upgrade, the device could become inoperable.

## 4.4. Programming Stack Settings in Tool Suite

The Serial Base contains settings, such as power settings and stack-wide Modbus settings that you program on the Serial Base device. The Serial Base then sends those settings to each Expansion Module in the stack. You can only set these settings on the Serial Base.

### Procedure

1. In Tool Suite, click **Configuration** in the **Applications** pane. (Figure 12)  
The **Configuration** window opens.

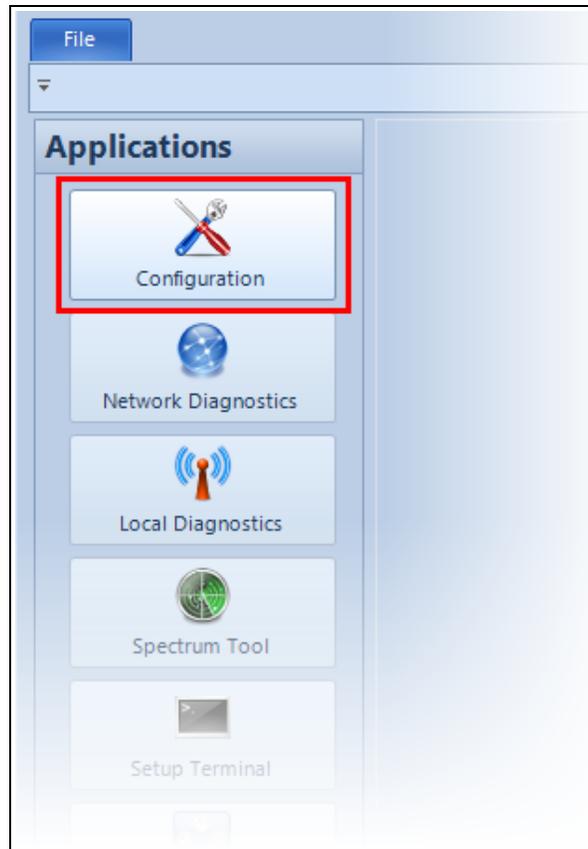

**Figure 12: Configuration button**

2. In the **Networks** section of the **Configuration** ribbon, select the network the I/O devices reside in.

**Note:** For information about adding networks, see the Tool Suite **User Manual**.

3. Create a template to load to a device at a later time:
  - a. Click **Template Devices** at the bottom of the **Device** tree.
  - b. Right-click anywhere in the **Device** tree and select **Add > Serial Base Template** to add a Serial Base.
  - c. Name the device.
  - d. Select the module type and click **Add**.

**Note:** When programming a device directly, see the [Reading Serial Bases and Expansion Modules in Tool Suite \(on page 21\)](#) to load the current device settings. The device stack is shown in the **Template Devices** tab.

4. Add an Expansion Module:
  - a. Add a Serial Base.
  - b. Right-click the Serial Base in the **Device** tree and select **Add Expansion Module**.
  - c. Name the device.
  - d. Select the module type and click **Add**.
5. In the **Device** tree, select the device to configure.  
The current settings appear in the right pane and are grouped by channel type.



**Figure 13: (0) Universal Channels in the IO Tool Suite tabs**

**Note:** If setting a Serial Base, set the settings that apply to the entire stack. For more information, see [Settings That Apply to the Entire Stack \(on page 30\)](#).

6. Click **Stack Settings** tab.
7. Send the configurations to a device by:
  - a. Send only the changed parameters to a single device in the stack:

**Important!** This option is only available if **Read Serial Base** is selected and are NOT sending parameter settings from a template to the device.

- i. Select the device in the **Configuration** application.
    - ii. Click **Quick** in the **Device Title** ribbon.
  - b. Send all the settings for all parameters:
    - i. Select the device in the **Configuration** application.
    - ii. Click **All** in the **Device Title** ribbon.
  - c. Set a device back to its factory default settings
    - i. Select the device in the **Configuration** application.
    - ii. Click **Default** in the **Device Title** ribbon.

## 4.5. Settings That Apply to the Entire Stack

These parameters are set on the Serial Base and apply to the Serial Base and to each Expansion Module in the stack attached to the serial base. The parameters that can also be set through the Modbus interface include the Modbus register in the description.

- [Serial Port Communication between the Computer and Stack \(on page 30\)](#)
- [Communication Timeout Settings and Required Stack Power \(on page 31\)](#)
- [Communication and Message Characteristics of Modbus \(on page 31\)](#)

### 4.5.1. Serial Port Communication between the Computer and Stack

Set these parameters to establish the serial port communication settings between the computer and the stack.

Serial Port Communication between the Computer and Stack	
Field	Description
Serial Protocol	<p>The protocol the serial port uses:</p> <ul style="list-style-type: none"> <li>• RS232</li> <li>• RS422</li> <li>• RS485</li> </ul> <p>Modbus Register: 40129 Comm Connection</p>
Port Speed	<p>This is the baud rate between the computer and the data port.</p> <ul style="list-style-type: none"> <li>• The default baud rate is 19200.</li> <li>• Modbus Register: 40131 Comm Port Baud Rate</li> </ul>
Parity	<p>This is the data parity of the network.</p> <ul style="list-style-type: none"> <li>• The default is None.</li> <li>• Modbus Register: 40132 Comm Port Parity</li> </ul>
Stop Bits	<p>This is the amount of time the radio stops and ways at the end of each character to wait for the next start bit.</p> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>Note:</b> There currently is only one selection, <b>1-bit</b>.</p> </div> <ul style="list-style-type: none"> <li>• Modbus Register: 40133 Comm Port Stop Bits</li> </ul>

### 4.5.2. Communication Timeout Settings and Required Stack Power

Set these parameters to establish the communication timeout settings and the amount of power the stack requires.

Communication Timeout Settings and Require Stack Power	
Field	Description
Default Delay	<p>This is the time the radio waits to receive a Modbus command or query before a communication timeout occurs.</p> <ul style="list-style-type: none"> <li>If a communication timeout occurs, the default state for the module's channels are enabled.</li> <li>Default states are defined in the <b>Default AO Command</b> and <b>Default DO, Sensor Power State</b> Modbus registers.</li> </ul> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> If these registers are not set, the factory default settings are used.</p> </div>
Power Mode	<p>This allows the Serial Base and all the Expansion Modules in the stack to use less power.</p> <p>The options are Regular and Low.</p>

### 4.5.3. Communication and Message Characteristics of Modbus

Set these parameters to establish the communication and message characteristics of the Modbus interface.

Communication and Message Characteristics of Modbus	
Field	Description
Modbus Address Mode	<p>This setting determines the range of acceptable Modbus IDs for the device.</p> <ul style="list-style-type: none"> <li>If set to 8-Bit, the Modbus ID can be between 1 and 246.</li> <li>If set to 16-Bit, the Modbus ID can be between 1 and 65535.</li> </ul>
Modbus ID	<p>This is the Modbus identification number for the device.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> The acceptable range of IDs is determined by the <b>Modbus Address Mode</b>.</p> </div>
Modbus Message Interval	<p>This setting determines the time in milliseconds</p> <ul style="list-style-type: none"> <li>Modbus Register: Modbus Min Transmit Inter-Message Interval</li> </ul>
AI Integer Result Justification	<p>This setting determines the alignment of the <b>AI Integer Result</b> register.</p> <p>The options include:</p> <ul style="list-style-type: none"> <li>Left</li> <li>Right</li> </ul>

Communication and Message Characteristics of Modbus	
Field	Description
Floating Point Word Order	<p>This setting determines the position of the Most Significant Word (MSW) and Least Significant Word (LSW) in the <b>AI Floating Point Result</b> register for all devices in the stack.</p> <ul style="list-style-type: none"> <li>Regular word order places the: <ul style="list-style-type: none"> <li>MSW at the lower address.</li> <li>LSW at the higher address.</li> </ul> </li> </ul> <p><b>Example:</b> MSW = 30032, LSW = 30033. Inverted word order places the LSW at the lower address and the MSW at the higher address.</p>
Long Integer Word Order	<p>This setting determines the position of the MSW and LSW in the <b>AI Result, Integer</b> registers for all devices in the stack.</p> <ul style="list-style-type: none"> <li>Regular word order places the: <ul style="list-style-type: none"> <li>MSW at the lower address.</li> <li>LSW at the higher address.</li> </ul> </li> </ul> <p><b>Example:</b> MSW = 30000, LSW = 30001. Inverted word order places the LSW at the lower address and the MSW at the higher address.</p>

## 5. Channel Functions and Specifications

---

All I/O Expansion devices have 12 I/O channels. All models feature four (4):

- [Universal Configurable Channels \(on page 36\)](#)
- [Input-Only Channels \(on page 51\)](#)
- [Electrically Isolated Channels \(on page 59\)](#)

The different models have these I/O configuration:

Model	I/O Configuration
<a href="#">IOE-4440 and IOEX-4440 Channels (on page 34)</a>	All four isolated channels are digital inputs.
<a href="#">IOE-4422 and IOEX-4422 Channels (on page 34)</a>	Two isolated channels are digital inputs and two are digital outputs.
<a href="#">IOE-4404 and IOEX-4404 Channels (on page 34)</a>	All four isolated channels are digital outputs.

## 5.1. IOE-4440 and IOEX-4440 Channels

These channels are available on the IOE-4440 and IOEX-4400 Channels.

**Note:** Any channel column in this table with a dot (•) is available in this model.

IOE-4440 and IOEX-4440 Channels													
		Universal Channels				Input-Only Channels				Isolated Channels			
4440 Channels	Number	1	2	3	4	5	6	7	8	9	10	11	12
Digital Input	12	•	•	•	•	•	•	•	•	•	•	•	•
Digital Output	4	•	•	•	•								
Analog Input	8	•	•	•	•	•	•	•	•				
Analog Output	4	•	•	•	•								
Sensor Power	4	•	•	•	•								

## 5.2. IOE-4422 and IOEX-4422 Channels

These channels are available on the IOE-4422 and IOEX-4422 Channels. Any channel column with a dot (•) in the table below is available in this model.

IOE-4422 and IOEX-4422 Channels													
		Universal Channels				Input-Only Channels				Isolated Channels			
4422 Channels	Number	1	2	3	4	5	6	7	8	9	10	11	12
Digital Input	10	•	•	•	•	•	•	•	•	•	•		
Digital Output	6	•	•	•	•							•	•
Analog Input	8	•	•	•	•	•	•	•	•				
Analog Output	4	•	•	•	•								
Sensor Power	4	•	•	•	•								


## 5.3. IOE-4404 and IOEX-4404 Channels

These channels are available on the IOE-4404 and IOEX-4404 Channels. Any channel column with a dot (•) in the table below is available in this model.

IOE-4404 and IOEX-4404 Channels													
		Universal Channels				Input-Only Channels				Isolated Channels			
4404 Channels	Number	1	2	3	4	5	6	7	8	9	10	11	12
Digital Input	8	•	•	•	•	•	•	•	•				
Digital Output	8	•	•	•	•					•	•	•	•
Analog Input	8	•	•	•	•	•	•	•	•				

IOE-4404 and IOEX-4404 Channels													
		Universal Channels				Input-Only Channels				Isolated Channels			
4404 Channels	Number	1	2	3	4	5	6	7	8	9	10	11	12
Analog Output	4	•	•	•	•								
Sensor Power	4	•	•	•	•								


The I/O channels are numbered left to right and each as a channel port and a signal ground port:

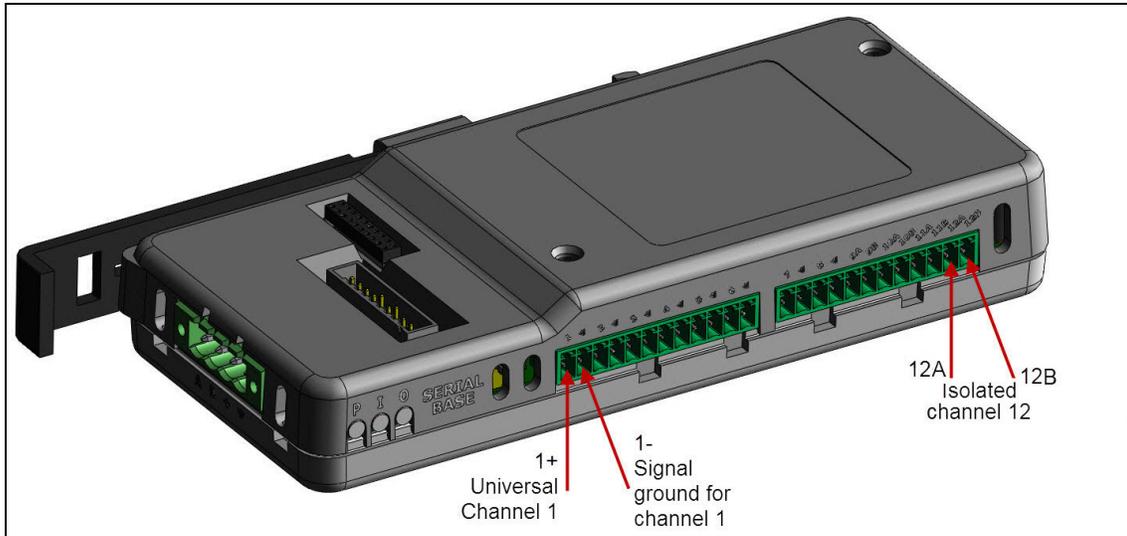

**Figure 14: IO Serial Base: IO Channel Connectors**

## 6. Universal Configurable Channels

Channels 1, 2, 3, and 4 on all Serial Base and Expansion Modules are Universal Channels. Universal Channels can be configured as these channels:

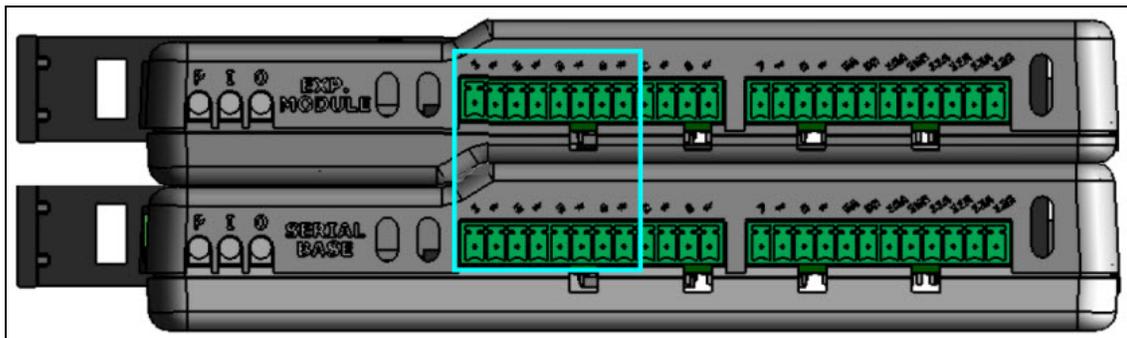

**Figure 15: IO Universal Channels**

These sections describe the features and characteristics of each universal channel configuration.

- [Digital Input - Universal Channel \(on page 37\)](#)
- [Digital Output - Universal Channel \(on page 39\)](#)
- [Analog Input - Universal Channel \(on page 42\)](#)
- [Analog Output - Universal Channel \(on page 47\)](#)
- [Sensor Power - Universal Channel \(on page 49\)](#)

## 6.1. Digital Input - Universal Channel

A Universal Digital Input provides data to these registers:

- **10000 to 10011: DI State** - The present state of the channel.
- **30064 to 30087: DI Counter** - The number of pulse edges seen on the channel.



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 6.1.1. Universal Digital Input Configuration

Use the information in this table to configure a Digital Input.

Universal Digital Input Configuration		
Tool Suite Field	Equivalent Register	Description
Counter Edge	96 to 106: DI Counter Falling Edge Increment	<p>This setting defines the pulse edge the <b>DI Counter</b> registers increments on.</p> <ul style="list-style-type: none"> <li>• Select <b>Falling Edge</b> to increment the <b>DI Counter</b> register when the input goes from 1 to 0. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> </ul> </li> <li>• Select <b>Rising Edge</b> to increment the <b>DI Counter</b> register when input goes from 0 to 1. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>
Resistor Pull	40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>• Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 1.</li> </ul> </li> <li>• Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 2.</li> </ul> </li> <li>• Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 0.</li> </ul> </li> </ul>

Universal Digital Input Configuration		
Tool Suite Field	Equivalent Register	Description
Counter Debounce	152 to 163: Pulse Counter Debounce	<p>This setting enables the system to take multiple samples before determining that an edge is real and not noise on the channel.</p> <p>Digital Inputs support:</p> <ul style="list-style-type: none"> <li>• pulse counting for input signals up to 100 Hz.</li> <li>• debounced pulse counting for input signals to 10 Hz.</li> </ul> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> High-speed counting is not de-bounced and inputs must not go below GND.</p> </div>

### 6.1.2. Digital Input Registers NOT in Tool Suite

Set additional functionality for a **Digital Input** using these registers that do not have an equivalent field in **Tool Suite**.

Digital Input Registers NOT in Tool Suite	
Register	Description
72 to 83: DI Counter Clear	<p>Clears the Digital Input counter to 0.</p> <p>Critical counting ensures that each pulse is reported by only clearing pulses that have been read.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Clear</b> the register description <a href="#">72 to 83: DI Counter Clear (on page 81)</a>.</p> </div>
136 to 147: DI Counter Latch	<p>Scans for the input change at a much slower speed than the duration of the pulse.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Latch</b> the register description <a href="#">136 to 147: DI Counter Latch (on page 83)</a>.</p> </div>

### 6.1.3. Universal Channel Configured as a Digital Input

A Universal Channel configured as a Digital Input has these specifications:

Universal Channel Configured as an Digital Input				
Item	Min	Typical	Max	Units
Input Low (OFF) voltage	0	-	2.5	V
Input High (ON) voltage	3.0	-	Actual Power Supply Voltage	V

Universal Channel Configured as an Digital Input				
Item	Min	Typical	Max	Units
Pulse counting frequency	-	-	100	Hz
De-bounced pulse counting frequency	-	-	10	Hz
Pulse width	4	-	-	ms
De-bounced pulse width	40	-	-	ms
Pull-up resistance	-	1	-	k $\Omega$
Pull-up voltage (measured externally)	-	3.0	-	V
Pull-down resistance to ground	-	10	-	k $\Omega$

## 6.2. Digital Output - Universal Channel

A universal channel configured as a Digital Output has these characteristics:

- Solid-state digital outputs with reverse-blocking **Schottky** diodes are rated at 1 A across the complete operating temperature range.
- Output voltage range up to 30 V, or device supply voltage, whichever is less.
- Circuitry protection.
  - If an overload occurs, the channel turns off automatically.
  - For more information, see the register description at [10024 to 10035: Circuitry Protection Active \(on page 83\)](#).
- Each channel has a ground pin for current return that must be used for large currents (over 0.1 A).
- Reports approximate amount of current flowing to ground.
- Configurable for normally open or normally closed.

**Note:** A Digital Output reports its current in milliAmps to the **30112 to 30119: DO Current** register.



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 6.2.1. Universal Digital Output Configuration

Use the information in this table to configure a Digital Output.

Universal Digital Output Configuration		
Tool Suite Field	Equivalent Register	Description
Apply Default Output	24 to 35: Apply Default DO, AO, Sensor Power	<p>If set to <b>Yes</b>:</p> <ul style="list-style-type: none"> <li>when a device powers up or a communication timeout has occurred, the channel uses the values set in the <b>Default DO, Sensor Power State</b> register.</li> <li>set the <b>Default Output</b> field or the <b>Default DO, Sensor Power State</b> register.</li> <li>In the Modbus register, this is <b>(1) ON</b>.</li> </ul> <p>If set to <b>No</b>:</p> <ul style="list-style-type: none"> <li>When a device powers up or a communication timeout has occurred, the channel remains off.</li> <li>In the Modbus register, this is <b>(0) OFF</b>.</li> </ul>
Default Output	48 to 59: Default DO, Sensor Power State	<p>If apply defaults on power up or after a communication timeout is selected, use this setting to set the default state of the channel.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>Default DO, Sensor Power State</b> register description <a href="#">48 to 59: Default DO, Sensor Power State (on page 81)</a>.</p> </div>
Monostable Time (msec)	40080 to 40091: DO Monostable Timeout	<ul style="list-style-type: none"> <li>Enter the amount of time in milliseconds from 1 to 60000 (1 minute) after which the Digital Output channel goes to the state defined in the <b>Default DO, Sensor Power State</b> register.</li> <li>When set to 0 milliseconds, the channel is bi-stable and maintains its most recent state until it receives a command to change its state.</li> </ul>

### 6.2.2. Tool Suite Serial Base Stack Settings

Set these parameters on the **Stack Settings** tab in **Tool Suite** for the Serial Base in the stack.

Tool Suite Serial Base Stack Settings	
Field	Description
Default Delay (sec)	<p>Enter the amount of time in seconds that an Expansion Module or Serial Base waits for a Modbus command or query before a communication timeout occurs.</p> <p>When a communication timeout occurs, the action defined in the <b>Apply Default DO, AO, Sensor Power</b> is taken.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the register description in <a href="#">24 to 35: Apply Default DO, AO, Sensor Power (on page 80)</a>.</p> </div>

### 6.2.3. Digital Output Registers NOT in Tool Suite

Set additional functionality for a **Digital Output** using these registers that do not have an equivalent field in **Tool Suite**.

Digital Output Registers NOT in Tool Suite	
Register	Description
0 to 11: DO, Sensor Power On	<ul style="list-style-type: none"> <li>Set to <b>(1) ON</b> to sink current to ground when the transistor powers up.</li> <li>When set to <b>(0) OFF</b>, the transistor turns off and the output remains floating, unless the <b>Resistor Pull Setting</b> register is set to 1 or 2.</li> </ul>
40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 1.</li> </ul> </li> <li>Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 2.</li> </ul> </li> <li>Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>In the Modbus register, this is 0.</li> </ul> </li> </ul>

### 6.2.4. Universal Channel Configured as a Digital Output

A universal channel configured as a Digital Output has these specifications.

Universal Channel Configured as a Digital Output				
Item	Min	Typical	Max	Units
Output ON sinking current	-	-	1	A
Output ON resistance to ground*	0	0.1	0.2	$\Omega$
Output ON circuitry protection limit	-	1.25	-	A
Output OFF resistance to ground	234	-	-	k $\Omega$
External load voltage connection	0	-	V <sub>bat</sub>	V
Pull-up resistance	-	1	-	k $\Omega$
Pull-up voltage (measured externally)	-	3.0	-	V
Pull-down resistance to ground	-	10	-	k $\Omega$

\*Dynamic resistance; a reverse-blocking **Shottky** diode is in series.

### 6.3. Analog Input - Universal Channel

A universal channel configured as an Analog Input returns data to the **30000 to 30016: AI Integer Result** register and **30032 to 30047: AI Floating Point Result** register associated with the channel. The channel also has circuitry protection. If an overload occurs, the channel turns off automatically. For more information, see the description for register [10024 to 10035: Circuitry Protection Active \(on page 83\)](#).



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 6.3.1. Universal Analog Input Configuration

Use the information in the following table to configure an Analog Input.

Universal Analog Input Configuration		
Tool Suite Field	Equivalent Register	Description
Current Span (μA) Voltage Span (mV)	40104 to 40111: AI Voltage Span 40120 to 40127: AI, AO Current Span	<p>Sets the high end, or range, of the Analog Input or Output.</p> <div style="border: 1px solid black; padding: 5px;"> <p><b>Note:</b> See the register description <a href="#">40120 to 40127: AI, AO Current Span (on page 89)</a> for setting recommendations.</p> <ul style="list-style-type: none"> <li>For 16-bit readings, set between 0 and 65535.</li> <li>For 20-bit readings, set between 0 and 1,048,575.</li> </ul> </div>
Filtering / Averaging	40040 to 40027: AI Filter Setting	<p>This sets a moving average, in seconds, for the <b>AI Integer Result</b> and <b>AI Floating Point Result</b> registers.</p> <div style="border: 1px solid black; padding: 5px;">  <p>Use this setting to help filter out signal noise.</p> </div> <p>Select from these settings:</p> <ul style="list-style-type: none"> <li>0 - Disabled</li> <li>1 - 10 seconds (0.1 Hz)</li> <li>2 - 25 seconds (0.04 Hz)</li> <li>3 - 50 seconds (0.02 Hz)</li> <li>4 - 100 seconds (0.01 Hz)</li> <li>5 - 250 seconds (0.004 Hz)</li> </ul> <div style="border: 1px solid black; padding: 5px;"> <p><b>FREEWAVE Recommends:</b> Leave this setting at <b>0</b>.</p> </div>
Resistor Pull	40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 1.</li> </ul> </li> <li>Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 2.</li> </ul> </li> <li>Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>In the Modbus register, this is 0.</li> </ul> </li> </ul>

Universal Analog Input Configuration		
Tool Suite Field	Equivalent Register	Description
Integer Type	112 to 119: AI Signed Integer Result	<p>This parameter sets the integer type to a signed or unsigned integer in the <b>AI Integer Result</b> register.</p> <ul style="list-style-type: none"> <li>• A signed integer is required to report negative input voltages if the RTU/PLC supports signed integers only.</li> <li>• Setting to <b>Signed</b> results in a signed integer. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> </ul> </li> <li>• Setting to <b>Unsigned</b> results in an unsigned integer returned in the <b>AI Integer Result</b> register. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> <li>• Setting this register to: <ul style="list-style-type: none"> <li>• 0 results in an unsigned integer returned in the AI Integer Result register.</li> <li>• Setting to 1 results in a signed integer.</li> </ul> </li> </ul>
Voltage Or Current	120 to 127: AI Current Mode	<p>Select <b>Voltage</b> to return information in Volts (V). In the Modbus register, this is (1) ON.</p> <p>Select <b>Current</b> to return current information in milliAmps (mA). In the Modbus register, this is (0) OFF.</p> <ul style="list-style-type: none"> <li>• 20-bit analog-to-digital converter yields 0.10% reading accuracy across entire operating temperature for voltage and current input signals.</li> <li>• Voltage range supports 1 to 5 V and 0 to 10 V analog signals. <ul style="list-style-type: none"> <li>• Complete voltage range is -2.5 to 12.5 V.</li> </ul> </li> <li>• Current range supports 4 to 20 mA analog signals. <ul style="list-style-type: none"> <li>• Complete current range is 0 to 25 mA.</li> </ul> </li> </ul>
Zero Current (mA) Zero Voltage (mV)	40112 to 40119: AI, AO Zero Current 40096 to 40103: AI Zero Voltage	<p>This setting calibrates the low end of the Analog Input or Output to zero.</p> <p>Set between 0 to 10000 mV or mA depending on the setting in the <b>Voltage Or Current</b> field.</p>

### 6.3.2. Tool Suite Serial Base Stack Settings

Set these parameters on the **Stack Settings** tab in **Tool Suite** for the Serial Base in the stack.

Tool Suite Serial Base Stack Settings	
Field	Description
Floating Point Word Order	<p>This setting determines the position of the Most Significant Word (MSW) and Least Significant Word (LSW) in the <b>AI Floating Point Result</b> register for all devices in the stack.</p> <ul style="list-style-type: none"> <li>Regular word order places the:               <ul style="list-style-type: none"> <li>MSW at the lower address.</li> <li>LSW at the higher address.</li> </ul> </li> </ul> <div style="border: 1px solid gray; padding: 5px; margin-top: 10px;"> <p><b>Example:</b> MSW = 30032, LSW = 30033. Inverted word order places the LSW at the lower address and the MSW at the higher address.</p> </div>
AI Integer Results Justification	<p>This setting determines the alignment of the <b>AI Integer Result</b> register.</p> <p>The options include:</p> <ul style="list-style-type: none"> <li>Left</li> <li>Right</li> </ul>

### 6.3.3. Universal Channel Configured as an Analog Input

A universal channel configured as an Analog Input has these specifications:

Universal Channel Configured as an Analog Input				
Item	Min	Typical	Max	Units
<b>Voltage Input</b>				
Analog input voltage	-2.5	-	lesser of 30 V or $V_{bat}$	V
Full-scale input voltage*	-	13.75	-	V
Resolution*	-	20	-	Bits
Scaling factor (all 20 bits)*	-	9.54	-	$\mu\text{V}/\text{LSB}$
Scaling factor (upper 16 bits)*	-	153	-	$\mu\text{V}/\text{LSB}$
Accuracy error (0 to 5 V input)	0	-	Greater of 1 mV or 0.10% of input	mA
<b>Current Input</b>				
Analog input current	0	-	25	mA

<b>Universal Channel Configured as an Analog Input</b>				
<b>Item</b>	<b>Min</b>	<b>Typical</b>	<b>Max</b>	<b>Units</b>
Circuitry protection limit	-	25	-	mA
Internal sense resistor	249	250	251	$\Omega$
Full-scale input current range*	-	40	-	mA
Resolution	-	20	-	Bits
Scaling factor (all 20 bits)*	-	38.1	-	nA/LSB
Scaling factor (upper 16 bits)*	-	610	-	na/LSB
Accuracy error (4 to 20 mA input)	0	-	Greater of 4 $\mu$ A or 0.10% of input	

\*These settings apply only when zero and span registers are set to 0 (default)

## 6.4. Analog Output - Universal Channel



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 6.4.1. Universal Analog Output Configuration

Use the information in this table to configure an Analog Output.

Universal Analog Output Configuration		
Tool Suite Field	Equivalent Register	Description
Default Output	40008 to 40011: Default AO Command	If apply defaults on power up or after a communication timeout is selected, use this setting to set the default state of the channel.  <b>Note:</b> For more information, see the <b>Default DO, Sensor Power State</b> register description <a href="#">48 to 59: Default DO, Sensor Power State (on page 81)</a> .
Apply Default Output	24 to 35: Apply Default DO, AO, Sensor Power	If set to <b>Yes</b> : <ul style="list-style-type: none"> <li>When a device powers up or a communication timeout has occurred, the channel uses the values set in the <b>AO Command</b> register. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(1) ON</b>.</li> <li>Set the <b>Default Output</b> field or the <b>Default AO Command</b> register.</li> </ul> </li> </ul> If set to <b>No</b> : <ul style="list-style-type: none"> <li>When a device powers up or a communication timeout has occurred, the factory defaults are applied to the channel. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>
Offset / Zero	40112 to 40119: AI, AO Zero Current	This setting calibrates the low end of the Analog Input or Output to zero.  Set between 0 to 10000 mV or mA depending on the setting in the <b>Voltage Or Current</b> field.

Universal Analog Output Configuration		
Tool Suite Field	Equivalent Register	Description
Resistor Pull	40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 1.</li> </ul> </li> <li>Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 2.</li> </ul> </li> <li>Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>In the Modbus register, this is 0.</li> </ul> </li> </ul>
Scaling	40072 to 40075: AO Resolution	<p>This sets the resolution of the <b>AO Command</b> register.</p> <ul style="list-style-type: none"> <li>The current range supports 4 to 20 mA analog signals.</li> <li>The complete current range is 0 to 25 mA.</li> </ul> <p>Set to one of these options:</p> <ul style="list-style-type: none"> <li>microAmps (1 microAmp per bit)</li> <li>12-bit resolution</li> <li>14-bit resolution</li> <li>15-bit resolution. <ul style="list-style-type: none"> <li>This is the recommended setting PLCs or RTUs that only support 16-bit signed integers.</li> </ul> </li> <li>16-bit resolution</li> </ul>
Span	40112 to 40119: AI, AO Zero Current 40120 to 40127: AI, AO Current Span	<p>Sets the high end, or range, of the Analog Input or Output.</p> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>Note:</b> See the register description <a href="#">40120 to 40127: AI, AO Current Span (on page 89)</a> for setting recommendations.</p> </div> <ul style="list-style-type: none"> <li>For 16-bit readings, set between 0 and 65535.</li> <li>For 20-bit readings, set between 0 and 1,048,575.</li> </ul>

### 6.4.2. Universal Channel Configured as an Analog Output

A universal channel configured as a Analog Output has these specifications:

Universal Channel Configured as an Analog Output				
Item	Min	Typical	Max	Units
Analog output current	0	-	22	mA
Full-scale output current*	-	25	-	mA
Resolution	-	25	-	Bits
Scaling factor*	-	1	-	μA/LSB
Voltage on output pin	-	-	V <sub>BAT</sub> -0.5	V
Accuracy error (at 20 mA output)	-0.25	-	0.25	%

\*These settings apply only when the zero and range registers are set to 0 (default).

### 6.5. Sensor Power - Universal Channel

A universal channel configured as a Sensor Power channel provides:

- Power for sensors and transmitters up to 50 mA.
- Voltage provided to the transmitter is roughly equal to the power provided to the Serial Base or Expansion Module, minus approximately 0.5 V, minus load current, multiplied by 10 ohms.
- Circuitry protection.
  - If an overload occurs, the channel turns off automatically.
  - For more information, see the register description for [10024 to 10035: Circuitry Protection Active \(on page 83\)](#).



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 6.5.1. Universal Sensor Power Channel Configuration

Use the information in this table to configure a Sensor Power channel.

Universal Sensor Power Channel Configuration		
Tool Suite Field	Equivalent Register	Description
Default Output	48 to 59: Default DO, Sensor Power State	<p>If apply defaults on power up or after a communication timeout is selected, use this setting to set the default state of the channel.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>Default DO, Sensor Power State</b> register description <a href="#">48 to 59: Default DO, Sensor Power State (on page 81)</a>.</p> </div>
Apply Default Output	24 to 35: Apply Default DO, AO, Sensor Power	<p>If set to <b>Yes</b>:</p> <ul style="list-style-type: none"> <li>When a device powers up or a communication timeout has occurred, the channel uses the values set in the <b>DO, Sensor Power On</b> register. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(1) ON</b>.</li> <li>Set the <b>Default Output</b> field or the <b>Default DO, Sensor Power</b> register.</li> </ul> </li> </ul> <p>If set to <b>No</b>:</p> <ul style="list-style-type: none"> <li>When a device powers up or a communication timeout has occurred, the factory defaults are applied to the channel. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>

### 6.5.2. Universal Channel Configured a Sensor Power


A universal channel configured as Sensor Power has these characteristics.

Universal Channel Configured a Sensor Power				
Item	Min	Typical	Max	Units
Voltage output	$V_{bat} - 1$	$V_{bat} - 0.5$	$V_{bat}$	V
Current output	0	-	50	mA
Circuitry protection limit	-	52	-	mA

## 7. Input-Only Channels

---

- Channels 5, 6, 7, and 8 on all Serial Bases and Expansion Modules are input-only channels.
- Input-only channels can be configured as Digital Input and Analog Input.

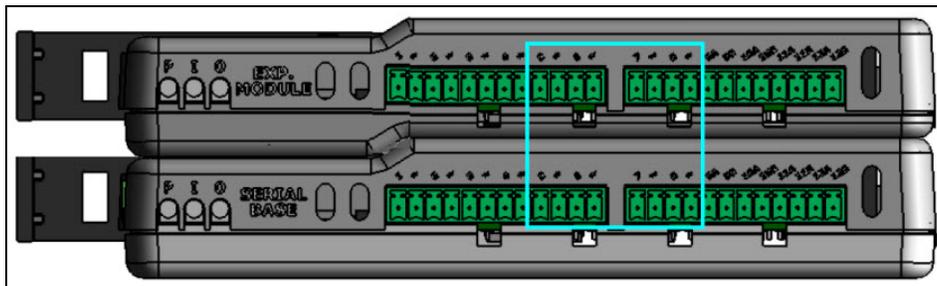

**Figure 16: IO Input-only Channels**

These sections describe the features and characteristics of each input-only channel configuration.

- [Digital Input - Input-Only Channel \(on page 52\)](#)
- [Analog Input - Input-Only Channel \(on page 55\)](#)

## 7.1. Digital Input - Input-Only Channel

An input-only channel configured as a Digital Input provides data to these registers:

- **10000 to 10011: DI State** - The present state of the channel.
- **30064 to 30087: DI Counter** - The number of pulse edges seen on the channel.



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 7.1.1. Input-Only Channel Digital Input Configuration

**Caution:** For accurate counting at high speed, the voltage at the Digital Input pin must NOT drop below 0 V.



Proper grounding techniques and short wiring connections are necessary to ensure accurate counting for high speed signals.

If the voltage at the Digital Input pin drops below 0 V, there may be false edges detected and the Digital Input pulse count can be higher than expected.

Use the information in this table to configure an input-only channel Digital Input.

Input-Only Channel Digital Input Configuration		
Tool Suite Field	Register	Description
Clear Counter on Read	64 to 71: Clear Counter on Read	This setting determines whether the Digital Input Counter is reset to zero (0) when read. <ul style="list-style-type: none"> <li>• Select <b>Enabled</b> to set the channel to reset to zero (0) when read.</li> <li>• They will NOT erase automatically.</li> <li>• Select <b>Disabled</b> to set the channel to accrue counts.</li> </ul>
Counter Debounce	152 to 163: Pulse Counter De-bounce	This setting enables the system to take multiple samples before determining that an edge is real and not noise on the channel. Digital Inputs support: <ul style="list-style-type: none"> <li>• pulse counting for input signals up to 100 Hz.</li> <li>• debounced pulse counting for input signals to 10 Hz.</li> </ul> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> High-speed counting is not de-bounced and inputs must not go below GND.</p> </div>

Input-Only Channel Digital Input Configuration		
Tool Suite Field	Register	Description
Counter Edge	96 to 106: DI Counter Falling Edge Increment	<p>This setting defines the pulse edge the <b>DI Counter</b> registers increments on.</p> <ul style="list-style-type: none"> <li>Select <b>Falling Edge</b> to increment the <b>DI Counter</b> register when the input goes from 1 to 0. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(1) ON</b>.</li> </ul> </li> <li>Select <b>Rising Edge</b> to increment the <b>DI Counter</b> register when input goes from 0 to 1. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>
Counting Speed	92 to 95: High-Speed DI Counter on Isolated	<p>Determines which channels use pulse counting for input signals up to 10 kHz.</p> <p>If an input-only channel is set to high-speed, its corresponding isolated channel is set to standard speed.</p> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>Note:</b> For more information, see the <b>High-Speed DI Counter on Isolated</b> register description <a href="#">92 to 95: High-Speed DI Counter on Isolated (on page 81)</a>.</p> </div> <ul style="list-style-type: none"> <li>Select <b>Fast</b> to set the channel to high-speed. <ul style="list-style-type: none"> <li>In the Modbus register, this is <b>(1) ON</b>.</li> <li>Assign high-speed counting to only one channel of 5 or 9, 6 or 10, 7 or 11, and 8 or 12.</li> <li>High-speed counting is not de-bounced and inputs must not go below GND.</li> </ul> </li> <li>Select <b>Standard</b> to set the channel to standard-speed. <ul style="list-style-type: none"> <li>Standard speed counters support 100 Hz pulses, or 10 Hz pulses with de-bounce.</li> <li>In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>
Resistor Pull	40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 1.</li> </ul> </li> <li>Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 2.</li> </ul> </li> <li>Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>In the Modbus register, this is 0.</li> </ul> </li> </ul>

### 7.1.2. Digital Input Registers NOT in Tool Suite

Set additional functionality for a **Digital Input** using these registers that do not have an equivalent field in **Tool Suite**.

Digital Input Registers NOT in Tool Suite	
Register	Description
72 to 83: DI Counter Clear	<p>Clears the Digital Input counter to 0.</p> <p>Critical counting ensures that each pulse is reported by only clearing pulses that have been read.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Clear</b> the register description <a href="#">72 to 83: DI Counter Clear (on page 81)</a>.</p> </div>
136 to 147: DI Counter Latch	<p>Scans for the input change at a much slower speed than the duration of the pulse.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Latch</b> the register description <a href="#">136 to 147: DI Counter Latch (on page 83)</a>.</p> </div>

### 7.1.3. Input-only Channel Configured as an Digital Input

An input-only channel configured as a Digital Input has these specifications:

Input-Only Channel Configured as an Digital Input				
Item	Min	Typical	Max	Units
Input low (OFF) voltage	0	-	2.5	V
Input high (ON) voltage	3.0	-	Actual Power Supply Voltage	V
Pulse counting frequency, standard speed	-	-	100	Hz
Pulse counting frequency, high speed	-	-	10	kHz
Pulse counting frequency, de-bounced pulse	-	-	10	Hz
Pulse width, standard speed	4	-	-	ms
Pulse width, high-speed	40	-	-	μs
Pulse width, de-bounced	40	-	-	ms
Pull-up resistance	-	1	-	kΩ
Pull-up voltage (measured externally)	-	3.0	-	V
Pull-down resistance to ground	-	10	-	kΩ

## 7.2. Analog Input - Input-Only Channel

An input-only channel configured as an Analog Input returns data to the **3000 to 30016: AI Integer Result** register and **30032 to 30047: AI Floating Point Result** register associated with the channel. The channel has circuitry protection. If an overload occurs, the channel turns off automatically.

**Note:** For more information, see the description for register [10024 to 10035: Circuitry Protection Active](#) (on page 83).



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting a universal channel as a Sensor Power channel, an input-only channel, or an output-only channel as an Analog or a Digital Input or Output, see [Defining Channel Settings in Tool Suite](#) (on page 23).

### 7.2.1. Input-Only Analog Input Configuration Settings

Use the information in the following table to configure an Analog Input.

Input-Only Analog Input Configuration Settings		
Tool Suite Field	Equivalent Register	Description
Voltage Or Current	120 to 127: AI Current Mode	Select <b>Voltage</b> to return information in Volts (V). In the Modbus register, this is (1) ON. Select <b>Current</b> to return current information in milliAmps (mA). In the Modbus register, this is (0) OFF. <ul style="list-style-type: none"> <li>• 20-bit analog-to-digital converter yields 0.10% reading accuracy across entire operating temperature for voltage and current input signals.</li> <li>• Voltage range supports 1 to 5 V and 0 to 10 V analog signals.               <ul style="list-style-type: none"> <li>• Complete voltage range is -2.5 to 12.5 V.</li> </ul> </li> <li>• Current range supports 4 to 20 mA analog signals.               <ul style="list-style-type: none"> <li>• Complete current range is 0 to 25 mA.</li> </ul> </li> </ul>
Zero Current (mA) Zero Voltage (mV)	40112 to 40119: AI, AO Zero Current 40096 to 40103: AI Zero Voltage	This setting calibrates the low end of the Analog Input or Output to zero. Set between 0 to 10000 mV or mA depending on the setting in the <b>Voltage Or Current</b> field.

Input-Only Analog Input Configuration Settings		
Tool Suite Field	Equivalent Register	Description
Current Span ( $\mu$ A) Voltage Span (mV)	40104 to 40111: AI Voltage Span 40120 to 40127: AI, AO Current Span	<p>Sets the high end, or range, of the Analog Input or Output.</p> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>Note:</b> See the register description <a href="#">40120 to 40127: AI, AO Current Span (on page 89)</a> for setting recommendations.</p> </div> <ul style="list-style-type: none"> <li>• For 16-bit readings, set between 0 and 65535.</li> <li>• For 20-bit readings, set between 0 and 1,048,575.</li> </ul>
Resistor Pull	40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>• Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 1.</li> </ul> </li> <li>• Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 2.</li> </ul> </li> <li>• Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>• In the Modbus register, this is 0.</li> </ul> </li> </ul>
Filtering / Averaging	40040 to 40047: AI Filter Setting	<p>This sets a moving average, in seconds, for the <b>AI Integer Result</b> and <b>AI Floating Point Result</b> registers.</p> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;">  <p>Use this setting to help filter out signal noise.</p> </div> <p>Select from these settings:</p> <ul style="list-style-type: none"> <li>• 0 - Disabled</li> <li>• 1 - 10 seconds (0.1 Hz)</li> <li>• 2 - 25 seconds (0.04 Hz)</li> <li>• 3 - 50 seconds (0.02 Hz)</li> <li>• 4 - 100 seconds (0.01 Hz)</li> <li>• 5 - 250 seconds (0.004 Hz)</li> </ul> <div style="border: 1px solid black; padding: 5px; margin: 10px 0;"> <p><b>FREEWAVE Recommends:</b> Leave this setting at <b>0</b>.</p> </div>

Input-Only Analog Input Configuration Settings		
Tool Suite Field	Equivalent Register	Description
Integer Type	112 to 119: AI Signed Integer Result	<p>This parameter sets the integer type to a signed or unsigned integer in the <b>AI Integer Result</b> register.</p> <ul style="list-style-type: none"> <li>• A signed integer is required to report negative input voltages if the RTU/PLC supports signed integers only.</li> <li>• Setting to <b>Signed</b> results in a signed integer. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> </ul> </li> <li>• Setting to <b>Unsigned</b> results in an unsigned integer returned in the <b>AI Integer Result</b> register. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> <li>• Setting this register to: <ul style="list-style-type: none"> <li>• 0 results in an unsigned integer returned in the AI Integer Result register.</li> <li>• Setting to 1 results in a signed integer.</li> </ul> </li> </ul>

### 7.2.2. Tool Suite Serial Base Stack Settings

Set these parameters on the **Stack Settings** tab in **Tool Suite** for the Serial Base in the stack.

Tool Suite Serial Base Stack Settings	
Field	Description
Floating Point Word Order	<p>This setting determines the position of the Most Significant Word (MSW) and Least Significant Word (LSW) in the <b>AI Floating Point Result</b> register for all devices in the stack.</p> <ul style="list-style-type: none"> <li>• Regular word order places the: <ul style="list-style-type: none"> <li>• MSW at the lower address.</li> <li>• LSW at the higher address.</li> </ul> </li> </ul> <div style="border: 1px solid #ccc; padding: 5px; margin-top: 10px;"> <p><b>Example:</b> MSW = 30032, LSW = 30033. Inverted word order places the LSW at the lower address and the MSW at the higher address.</p> </div>
AI Integer Results Justification	<p>This setting determines the alignment of the <b>AI Integer Result</b> register.</p> <p>The options include:</p> <ul style="list-style-type: none"> <li>• Left</li> <li>• Right</li> </ul>

### 7.2.3. Input-only Channel Configured as an Analog Input

An input-only channel configured as an Analog Input has these specifications:


Input-only Configured as an Analog Input				
Item	Min	Typical	Max	Units
<b>Voltage Input</b>				
Analog input voltage	-2.5	-	30	V
Full-scale input voltage*	-	13.75	-	V
Resolution	-	20	-	Bits
Scaling factor (all 20 bits)*	-	9.54	-	μV/LSB
Scaling factor (upper 16 bits)*	-	153	-	μV/LSB
Accuracy error (0 to 5 V input)	0	-	Greater of 1 mV or 0.10% of input	mA
<b>Current Input</b>				
Analog input current	0	-	25	mA
Circuitry protection limit	-	25	-	mA
Internal sense resistor	249	250	251	Ω
Full-scale input current range*	-	40	-	mA
Resolution	-	20	-	Bits
Scaling factor (all 20 bits)*	-	38.1	-	nA/LSB
Scaling factor (upper 16 bits)*	-	610	-	nA/LSB
Accuracy error (4 to 20 mA input)	0	-	Greater of 4 μA or 0.10% of input	

\*These settings apply only when zero and span registers are set to 0 (default)

## 8. Electrically Isolated Channels

---

- Channels 9, 10, 11, and 12 are built in the factory for either Digital Input or Digital Output.
- These channels can only serve the function they were built for.

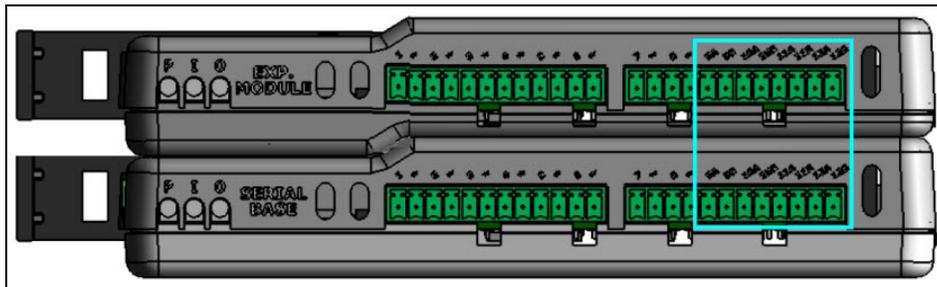

**Figure 17: IO Isolated Channels**

These sections describe the features and characteristics of each isolated channel configuration.

- [Digital Output - Isolated Channel \(on page 60\)](#)
- [Digital Input - Isolated Channel \(on page 62\)](#)

## 8.1. Digital Output - Isolated Channel

An isolated Digital Output reports its current in milliAmps to the **DO Current** register and has these characteristics:

- Mechanical relays capable of switching up to 2 A at 250 VDC or VAC
- Long life relays with 80,000 cycles
- Configured for normally open
- Circuitry protection. If an overload occurs, the channel turns off automatically.
- For more information, see the register description for [10024 to 10035: Circuitry Protection Active \(on page 83\)](#).



Configure a Sensor Power channel, an Analog or a Digital Input or Output settings in either **Tool Suite** or directly through the register settings.

**Note:** For information about setting an isolated channel as a Digital Output, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 8.1.1. Isolated Digital Output Configuration

Use the information in this table to configure a Digital Output.

Isolated Digital Output Configuration		
Tool Suite Field	Register	Description
Apply Default Output	24 to 35: Apply Default DO, AO, Sensor Power	<p>If set to <b>Yes</b>:</p> <ul style="list-style-type: none"> <li>• When a device powers up or a communication timeout has occurred, the channel uses the values set in the <b>Default DO, Sensor Power State</b> register.</li> <li>• Set the <b>Default Output</b> field or the <b>Default DO, Sensor Power State</b> register.</li> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> </ul> <p>If set to <b>No</b>:</p> <ul style="list-style-type: none"> <li>• When a device powers up or a communication timeout has occurred, the channel remains off.</li> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul>

Isolated Digital Output Configuration		
Tool Suite Field	Register	Description
Default Output	48 to 59: Default DO, Sensor Power State	<p>If apply defaults on power up or after a communication timeout is selected, use this setting to set the default state of the channel.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>Default DO, Sensor Power State</b> register description <a href="#">48 to 59: Default DO, Sensor Power State (on page 81)</a>.</p> </div>
Monostable Time (msec)	40080 to 40091: DO Monostable Timeout	<ul style="list-style-type: none"> <li>Enter the amount of time in milliseconds from 1 to 60000 (1 minute) after which the Digital Output channel goes to the state defined in the <b>Default DO, Sensor Power State</b> register.</li> <li>When set to 0 milliseconds, the channel is bi-stable and maintains its most recent state until it receives a command to change its state.</li> </ul>

### 8.1.2. Tool Suite Serial Base Stack Settings

Set these parameters on the **Stack Settings** tab in **Tool Suite** for the Serial Base in the stack.

Tool Suite Serial Base Stack Settings	
Field	Description
Default Delay (sec)	<p>Enter the amount of time in seconds that an Expansion Module or Serial Base waits for a Modbus command or query before a communication timeout occurs.</p> <p>When a communication timeout occurs, the action defined in the <b>Apply Default DO, AO, Sensor Power</b> is taken.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the register description in <a href="#">24 to 35: Apply Default DO, AO, Sensor Power (on page 80)</a>.</p> </div>

### 8.1.3. Digital Output Registers NOT in Tool Suite

Set additional functionality for a **Digital Output** using these registers that do not have an equivalent field in **Tool Suite**.

Digital Output Registers NOT in Tool Suite	
Register	Description
0 to 11: DO, Sensor Power On	<ul style="list-style-type: none"> <li>Set to <b>(1) ON</b> to sink current to ground when the transistor powers up.</li> <li>When set to <b>(0) OFF</b>, the transistor turns off and the output remains floating, unless the <b>Resistor Pull Setting</b> register is set to 1 or 2.</li> </ul>

**Digital Output Registers NOT in Tool Suite**

Register	Description
40056 to 40063: Resistor Pull Setting	<ul style="list-style-type: none"> <li>Select <b>Pull-Down</b> to connect a pull-down resistor to ground for use with closed-contact-to-voltage inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 1.</li> </ul> </li> <li>Select <b>Pull-Up</b> to connect a pull-up resistor for closed-contact-to-ground inputs. <ul style="list-style-type: none"> <li>In the Modbus register, this is 2.</li> </ul> </li> <li>Select <b>None</b> to disable both resistors. <ul style="list-style-type: none"> <li>In the Modbus register, this is 0.</li> </ul> </li> </ul>

**8.1.4. Isolated Channel Configured as an Digital Output**

An isolated channel configured as a Digital Output has the following specifications:

Isolated Channel Configured as an Digital Output				
Item	Min	Typical	Max	Units
Output ON current across terminals	-	-	2	A
Output ON resistance across terminals	0	-	0.120	$\Omega$
Output OFF resistance across terminals	10	-	-	M $\Omega$
External AC or DC voltage connection	0	-	250	V

**8.2. Digital Input - Isolated Channel**

A isolated Digital Input provides data to the following registers:

- 10000 to 10011: DI State** - The present state of the channel.
- 30064 to 30087: DI Counter** - The number of pulse edges seen on the channel.

An isolated channel configured as a Digital Input accepts 30 V<sub>DC</sub> input signals regardless of device voltage.

You can configure a Digital Input's settings in either Tool Suite or directly through the register settings.

**Note:** For information about setting an isolated channel as a Digital Input, see [Defining Channel Settings in Tool Suite \(on page 23\)](#).

### 8.2.1. Isolated Digital Input Configuration

Use the information in this table to configure a Digital Input.

Isolated Digital Input Configuration		
Tool Suite Field	Register	Description
Counter Edge	96 to 106: DI Counter Falling Edge Increment	<p>This setting defines the pulse edge the <b>DI Counter</b> registers increments on.</p> <ul style="list-style-type: none"> <li>• Select <b>Falling Edge</b> to increment the <b>DI Counter</b> register when the input goes from 1 to 0.</li> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> <li>• Select <b>Rising Edge</b> to increment the <b>DI Counter</b> register when input goes from 0 to 1.</li> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul>
Counting Speed	92 to 95: High-Speed DI Counter on Isolated	<p>This setting determines which channels use pulse counting for input signals up to 10 kHz.</p> <p>If an input-only channel is set to be high-speed, its corresponding isolated channel is set to standard speed.</p> <ul style="list-style-type: none"> <li>• Select <b>Fast</b> to set the channel to high-speed. <ul style="list-style-type: none"> <li>• In the Modbus register, this is <b>(1) ON</b>.</li> </ul> </li> <li>• High-speed counting can only be assigned one channel of 5 or 9, 6 or 10, 7 or 11, and 8 or 12.</li> <li>• High-speed counting is not de-bounced and inputs must not go below GND.</li> <li>• Select <b>Standard</b> to set the channel to standard-speed. <ul style="list-style-type: none"> <li>• Standard speed counters support 100 Hz pulses, or 10 Hz pulses with de-bounce.</li> <li>• In the Modbus register, this is <b>(0) OFF</b>.</li> </ul> </li> </ul>

### 8.2.2. Digital Input Registers NOT in Tool Suite

Set additional functionality for a **Digital Input** using these registers that do not have an equivalent field in **Tool Suite**.

Digital Input Registers NOT in Tool Suite	
Register	Description
72 to 83: DI Counter Clear	<p>Clears the Digital Input counter to 0.</p> <p>Critical counting ensures that each pulse is reported by only clearing pulses that have been read.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Clear</b> the register description <a href="#">72 to 83: DI Counter Clear (on page 81)</a>.</p> </div>
136 to 147: DI Counter Latch	<p>Scans for the input change at a much slower speed than the duration of the pulse.</p> <div style="border: 1px solid black; padding: 5px; margin-top: 10px;"> <p><b>Note:</b> For more information, see the <b>DI Counter Latch</b> the register description <a href="#">136 to 147: DI Counter Latch (on page 83)</a>.</p> </div>

### 8.2.3. Isolated Channel Configured as an Digital Input

An isolated channel configured as a Digital Input has these specifications:

Isolated Channel Configured as an Digital Input					
Item	Symbol	Min	Typical	Max	Units
Input Low (OFF) voltage	$V_{il}$	0	-	1.2	V
Input High (ON) voltage	$V_{iH}$	3.2	-	30	V
Pulse counting frequency, standard speed	$F_{pc}$	-	-	100	Hz
Pulse counting frequency, high speed	$F_{pc}$	-	-	10	kHz
Pulse counting frequency, de-bounced	$F_{pcdb}$	-	-	10	Hz
Pulse width, standard speed	$T_{pc}$	4	-	-	ms
Pulse width, high-speed	$T_{pc}$	40	-	-	$\mu$ s
Pulse width, de-bounced	$T_{pcdb}$	40	-	-	ms

## 9. Quick Reference Modbus Register Map

This table summarizes commonly used coils and registers.

**Note:** Protocol Addressing in the table is Base 0.

Modbus Quick Reference												
	Universal Channels				Input-Only Channels				Isolated Channels			
Channel >>	1	2	3	4	5	6	7	8	9	10	11	12
<b>Holding (Read / Write) Coils</b>												
Digital Output, Sensor Power Setting	0	1	2	3	-	-	-	-	8	9	10	11
Clear Counter on Read	64	65	66	67	68	69	70	71	-	-	-	-
Digital Input Counter Clear	72	73	74	75	76	77	78	79	80	81	82	83
Digital Input Counter Latch	136	137	138	139	140	141	142	143	144	145	146	147
<b>Input (Read-Only) Coils</b>												
Digital Input Status	10000	10001	10002	10003	10004	10005	10006	10007	10008	10009	10010	10011
Circuitry Protection Status	10024	10025	10036	10027	10028	10029	10030	10031	10032	10033	10034	10035
<b>Input (Read-Only) Registers</b>												
AI Integer Result	30000	30002	30004	30006	30008	30010	30012	30014	-	-	-	-
AI Floating Point Result	30032	30034	30036	30038	30040	30042	30044	30046	-	-	-	-
Digital Input Counter	30064	30066	30068	30070	30072	30074	30076	30078	30080	30082	30084	30086
Modbus Request Counter	30096	-	-	-	-	-	-	-	-	-	-	-
Digital Output Current	30112	30113	30114	30115	-	-	-	-	-	-	-	-
Device Temperature	30152	-	-	-	-	-	-	-	-	-	-	-
Device Supply Voltage	30153	-	-	-	-	-	-	-	-	-	-	-
<b>Holding (Read / Write) Registers</b>												
Analog Output Setting	40000	40001	40002	40003	-	-	-	-	-	-	-	-
Communication Timeout Latch	40129	-	-	-	-	-	-	-	-	-	-	-

## 10. Modbus Register Map

---

These sections provide a map and details for each entity in the Modbus register for the I/O Expansion Module and the Serial Base. The register map is grouped by the register type:

- [Holding Coils \(Read / Write Commands\) \(on page 67\)](#)
- [Discrete Inputs \(Read-Only Commands\) \(on page 71\)](#)
- [Input Registers \(Read-Only Commands\) \(on page 72\)](#)
- [Holding Registers \(Read / Write Commands\) \(on page 73\)](#)
- [Modbus Timing \(on page 77\)](#)

**Important!** Non-volatile registers have a limited number (> 10,000) of lifetime write cycles and should not be used in place of volatile settings to control I/O activity.

When using the Modbus register:

- Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

- Add 1 to registers in protocol addressing (Base 0) to obtain PLC addressing (Base 1).

**Important!** Modbus register readings are accurate 10 seconds after powering on the device.

**Note:** For a reference of the most often used registers, see [Quick Reference Modbus Register Map \(on page 65\)](#).

## 10.1. Holding Coils (Read / Write Commands)

Use these Modbus command codes to read and write these coils:

- 1 - Read Coils
- 5 - Write Single Coil
- 15 - Write Multiple Coils

**Note:** Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

**Note:** Registers in **YELLOW** are non-volatile registers whose values are saved through power loss. All other register settings are lost upon power loss.

Holding Coils (Read / Write)				
Address Protocol	PLC	Entity	I/O Channel	Bits
0	1	DO, SENSOR POWER ON	1	1
1	2	DO, SENSOR POWER ON	2	1
2	3	DO, SENSOR POWER ON	3	1
3	4	DO, SENSOR POWER ON	4	1
8	9	DO, SENSOR POWER ON	9	1
9	10	DO, SENSOR POWER ON	10	1
10	11	DO, SENSOR POWER ON	11	1
11	12	DO, SENSOR POWER ON	12	1
24	25	APPLY DEFAULT DO, AO, SENSOR POWER	1	1
25	26	APPLY DEFAULT DO, AO, SENSOR POWER	2	1
26	27	APPLY DEFAULT DO, AO, SENSOR POWER	3	1
27	28	APPLY DEFAULT DO, AO, SENSOR POWER	4	1
32	33	APPLY DEFAULT DO, AO, SENSOR POWER	9	1
33	34	APPLY DEFAULT DO, AO, SENSOR POWER	10	1
34	35	APPLY DEFAULT DO, AO, SENSOR POWER	11	1
35	36	APPLY DEFAULT DO, AO, SENSOR POWER	12	1
48	49	DEFAULT DO, SENSOR POWER STATE	1	1
49	50	DEFAULT DO, SENSOR POWER STATE	2	1
50	51	DEFAULT DO, SENSOR POWER STATE	3	1

Holding Coils (Read / Write)				
Address Protocol	PLC	Entity	I/O Channel	Bits
51	52	DEFAULT DO, SENSOR POWER STATE	4	1
56	57	DEFAULT DO, SENSOR POWER STATE	9	1
57	58	DEFAULT DO, SENSOR POWER STATE	10	1
58	59	DEFAULT DO, SENSOR POWER STATE	11	1
59	60	DEFAULT DO, SENSOR POWER STATE	12	1
64	65	CLEAR COUNTER ON READ	1	1
65	66	CLEAR COUNTER ON READ	2	1
66	67	CLEAR COUNTER ON READ	3	1
67	68	CLEAR COUNTER ON READ	4	1
68	69	CLEAR COUNTER ON READ	5	1
69	70	CLEAR COUNTER ON READ	6	1
70	71	CLEAR COUNTER ON READ	7	1
71	72	CLEAR COUNTER ON READ	8	1
72	73	DI COUNTER CLEAR	1	1
73	74	DI COUNTER CLEAR	2	1
74	75	DI COUNTER CLEAR	3	1
75	76	DI COUNTER CLEAR	4	1
76	77	DI COUNTER CLEAR	5	1
77	78	DI COUNTER CLEAR	6	1
78	79	DI COUNTER CLEAR	7	1
79	80	DI COUNTER CLEAR	8	1
80	81	DI COUNTER CLEAR	9	1
81	82	DI COUNTER CLEAR	10	1
82	83	DI COUNTER CLEAR	11	1
83	84	DI COUNTER CLEAR	12	1
92	93	HIGH-SPEED DI COUNTER ON ISOLATED	5, 9	1
93	94	HIGH-SPEED DI COUNTER ON ISOLATED	6, 10	1
94	95	HIGH-SPEED DI COUNTER ON ISOLATED	7, 11	1
95	96	HIGH-SPEED DI COUNTER ON ISOLATED	8, 12	1
96	97	DI COUNTER FALLING EDGE INCREMENT	1	1
97	98	DI COUNTER FALLING EDGE INCREMENT	2	1
98	99	DI COUNTER FALLING EDGE INCREMENT	3	1

Holding Coils (Read / Write)				
Address Protocol	PLC	Entity	I/O Channel	Bits
99	100	DI COUNTER FALLING EDGE INCREMENT	4	1
100	101	DI COUNTER FALLING EDGE INCREMENT	5	1
101	102	DI COUNTER FALLING EDGE INCREMENT	6	1
102	103	DI COUNTER FALLING EDGE INCREMENT	7	1
103	104	DI COUNTER FALLING EDGE INCREMENT	8	1
104	105	DI COUNTER FALLING EDGE INCREMENT	9	1
105	106	DI COUNTER FALLING EDGE INCREMENT	10	1
106	107	DI COUNTER FALLING EDGE INCREMENT	11	1
107	108	DI COUNTER FALLING EDGE INCREMENT	12	1
112	113	AI SIGNED INTEGER RESULT	1	1
113	114	AI SIGNED INTEGER RESULT	2	1
114	115	AI SIGNED INTEGER RESULT	3	1
115	116	AI SIGNED INTEGER RESULT	4	1
116	117	AI SIGNED INTEGER RESULT	5	1
117	118	AI SIGNED INTEGER RESULT	6	1
118	119	AI SIGNED INTEGER RESULT	7	1
119	120	AI SIGNED INTEGER RESULT	8	1
120	121	AI, AO CURRENT, VOLTAGE MODE	1	1
121	122	AI, AO CURRENT, VOLTAGE MODE	2	1
122	123	AI, AO CURRENT, VOLTAGE MODE	3	1
123	124	AI, AO CURRENT, VOLTAGE MODE	4	1
124	125	AI, AO CURRENT, VOLTAGE MODE	5	1
125	126	AI, AO CURRENT, VOLTAGE MODE	6	1
126	127	AI, AO CURRENT, VOLTAGE MODE	7	1
127	128	AI, AO CURRENT, VOLTAGE MODE	8	1
136	137	DI COUNTER LATCH	1	1
137	138	DI COUNTER LATCH	2	1
138	139	DI COUNTER LATCH	3	1
139	140	DI COUNTER LATCH	4	1
140	141	DI COUNTER LATCH	5	1
141	142	DI COUNTER LATCH	6	1
142	143	DI COUNTER LATCH	7	1

Holding Coils (Read / Write)				
Address Protocol	PLC	Entity	I/O Channel	Bits
143	144	DI COUNTER LATCH	8	1
144	145	DI COUNTER LATCH	9	1
145	146	DI COUNTER LATCH	10	1
146	147	DI COUNTER LATCH	11	1
147	148	DI COUNTER LATCH	12	1
152	153	PULSE COUNTER DEBOUNCE	1	1
153	154	PULSE COUNTER DEBOUNCE	2	1
154	155	PULSE COUNTER DEBOUNCE	3	1
155	156	PULSE COUNTER DEBOUNCE	4	1
156	157	PULSE COUNTER DEBOUNCE	5	1
157	158	PULSE COUNTER DEBOUNCE	6	1
158	159	PULSE COUNTER DEBOUNCE	7	1
159	160	PULSE COUNTER DEBOUNCE	8	1
160	161	PULSE COUNTER DEBOUNCE	9	1
161	162	PULSE COUNTER DEBOUNCE	10	1
162	163	PULSE COUNTER DEBOUNCE	11	1
163	164	PULSE COUNTER DEBOUNCE	12	1

## 10.2. Discrete Inputs (Read-Only Commands)

Use these Modbus command codes to read these discrete inputs:

- 2: Read Discrete Inputs

**Note:** Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

Discrete Inputs (Read-Only)				
Address Protocol	PLC	Entity	I/O Channel	Bits
10000	10001	DI STATE	1	1
10001	10002	DI STATE	2	1
10002	10003	DI STATE	3	1
10003	10004	DI STATE	4	1
10004	10005	DI STATE	5	1
10005	10006	DI STATE	6	1
10006	10007	DI STATE	7	1
10007	10008	DI STATE	8	1
10008	10009	DI STATE	9	1
10009	10010	DI STATE	10	1
10010	10011	DI STATE	11	1
10011	10012	DI STATE	12	1
10024	10025	CIRCUITRY PROTECTION ACTIVE	1	1
10025	10026	CIRCUITRY PROTECTION ACTIVE	2	1
10026	10027	CIRCUITRY PROTECTION ACTIVE	3	1
10027	10028	CIRCUITRY PROTECTION ACTIVE	4	1
10028	10029	CIRCUITRY PROTECTION ACTIVE	5	1
10029	10030	CIRCUITRY PROTECTION ACTIVE	6	1
10030	10031	CIRCUITRY PROTECTION ACTIVE	7	1
10031	10032	CIRCUITRY PROTECTION ACTIVE	8	1
10032	10033	CIRCUITRY PROTECTION ACTIVE	9	1
10033	10034	CIRCUITRY PROTECTION ACTIVE	10	1
10034	10035	CIRCUITRY PROTECTION ACTIVE	11	1
10035	10036	CIRCUITRY PROTECTION ACTIVE	12	1

### 10.3. Input Registers (Read-Only Commands)

Use these Modbus command codes to read these registers:

- 4 - Read Input Registers

**Note:** Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

Input Registers (Read-Only)				
Address Protocol	PLC	Entity	I/O Channel	Bits
30000/30001	30001/30002	AI INTEGER RESULT	1	32
30002/30003	30003/30004	AI INTEGER RESULT	2	32
30004/30005	30005/30006	AI INTEGER RESULT	3	32
30006/30007	30007/30008	AI INTEGER RESULT	4	32
30008/30009	30009/30010	AI INTEGER RESULT	5	32
30010/30011	30011/30012	AI INTEGER RESULT	6	32
30012/30013	30013/30014	AI INTEGER RESULT	7	32
30014/30015	30015/30016	AI INTEGER RESULT	8	32
30032/30033	30033/30034	AI FLOATING POINT RESULT	1	32
30034/30035	30035/30036	AI FLOATING POINT RESULT	2	32
30036/30037	30037/30038	AI FLOATING POINT RESULT	3	32
30038/30039	30039/30040	AI FLOATING POINT RESULT	4	32
30040/30041	30041/30042	AI FLOATING POINT RESULT	5	32
30042/30043	30043/30044	AI FLOATING POINT RESULT	6	32
30044/30045	30045/30046	AI FLOATING POINT RESULT	7	32
30046/30047	30047/30048	AI FLOATING POINT RESULT	8	32
30064/30065	30065/30066	DI COUNTER	1	32
30066/30067	30067/30068	DI COUNTER	2	32
30068/30069	30069/30070	DI COUNTER	3	32
30070/30071	30071/30072	DI COUNTER	4	32
30072/30073	30073/30074	DI COUNTER	5	32
30074/30075	30075/30076	DI COUNTER	6	32
30076/30077	30077/30078	DI COUNTER	7	32
30078/30079	30079/30080	DI COUNTER	8	32

Input Registers (Read-Only)				
Address Protocol	PLC	Entity	I/O Channel	Bits
30080/30081	30081/30082	DI COUNTER	9	32
30082/30083	30083/30084	DI COUNTER	10	32
30084/30085	30085/30086	DI COUNTER	11	32
30086/30087	30087/30088	DI COUNTER	12	32
30096	30097	MODBUS REQUEST COUNTER	-	16
30112	30113	DO CURRENT	1	16
30113	30114	DO CURRENT	2	16
30114	30115	DO CURRENT	3	16
30115	30116	DO CURRENT	4	16
30116	30117	DO CURRENT	5	16
30117	30118	DO CURRENT	6	16
30118	30119	DO CURRENT	7	16
30119	30120	DO CURRENT	8	16
30152	30153	DEVICE TEMPERATURE	-	16
30153	30154	VBATT VOLTAGE	-	16

## 10.4. Holding Registers (Read / Write Commands)

Use these Modbus command codes to read and write these registers:

- 3 - Read Holding Registers
- 6 - Write Single Register
- 16 - Write Multiple Registers

**Note:** Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

**Note:** Registers in **YELLOW** are non-volatile registers whose values are saved through power loss. All other register settings are lost upon power loss.

<b>Holding Registers (Read / Write)</b>				
<b>Address Protocol</b>	<b>PLC</b>	<b>Entity</b>	<b>I/O Channel</b>	<b>Bits</b>
40000	40001	AO COMMAND	1	16
40001	40002	AO COMMAND	2	16
40002	40003	AO COMMAND	3	16
40003	40004	AO COMMAND	4	16
40008	40009	DEFAULT AO COMMAND	1	16
40009	40010	DEFAULT AO COMMAND	2	16
40010	40011	DEFAULT AO COMMAND	3	16
40011	40012	DEFAULT AO COMMAND	4	16
40016	40017	CHANNEL MODE	1	16
40017	40018	CHANNEL MODE	2	16
40018	40019	CHANNEL MODE	3	16
40019	40020	CHANNEL MODE	4	16
40020	40021	CHANNEL MODE	5	16
40021	40022	CHANNEL MODE	6	16
40022	40023	CHANNEL MODE	7	16
40023	40024	CHANNEL MODE	8	16
40024	40025	CHANNEL MODE	9	16
40025	40026	CHANNEL MODE	10	16
40026	40027	CHANNEL MODE	11	16
40027	40028	CHANNEL MODE	12	16
40040	40041	AI FILTER SETTING	1	16
40041	40042	AI FILTER SETTING	2	16
40042	40043	AI FILTER SETTING	3	16
40043	40044	AI FILTER SETTING	4	16
40044	40045	AI FILTER SETTING	5	16
40045	40046	AI FILTER SETTING	6	16
40046	40047	AI FILTER SETTING	7	16
40047	40048	AI FILTER SETTING	8	16
40056	40057	RESISTOR PULL SETTING	1	16
40057	40058	RESISTOR PULL SETTING	2	16
40058	40059	RESISTOR PULL SETTING	3	16
40059	40060	RESISTOR PULL SETTING	4	16

<b>Holding Registers (Read / Write)</b>				
<b>Address Protocol</b>	<b>PLC</b>	<b>Entity</b>	<b>I/O Channel</b>	<b>Bits</b>
40060	40061	RESISTOR PULL SETTING	5	16
40061	40062	RESISTOR PULL SETTING	6	16
40062	40063	RESISTOR PULL SETTING	7	16
40063	40064	RESISTOR PULL SETTING	8	16
40072	40073	AO RESOLUTION	1	16
40073	40074	AO RESOLUTION	2	16
40074	40075	AO RESOLUTION	3	16
40075	40076	AO RESOLUTION	4	16
40080	40081	DO MONOSTABLE TIMEOUT	1	16
40081	40082	DO MONOSTABLE TIMEOUT	2	16
40082	40083	DO MONOSTABLE TIMEOUT	3	16
40083	40088	DO MONOSTABLE TIMEOUT	4	16
40088	40089	DO MONOSTABLE TIMEOUT	9	16
40089	40090	DO MONOSTABLE TIMEOUT	10	16
40090	40091	DO MONOSTABLE TIMEOUT	11	16
40091	40092	DO MONOSTABLE TIMEOUT	12	16
40096	40097	AI ZERO VOLTAGE	1	16
40097	40098	AI ZERO VOLTAGE	2	16
40098	40099	AI ZERO VOLTAGE	3	16
40099	40100	AI ZERO VOLTAGE	4	16
40100	40101	AI ZERO VOLTAGE	5	16
40101	40102	AI ZERO VOLTAGE	6	16
40102	40103	AI ZERO VOLTAGE	7	16
40103	40104	AI ZERO VOLTAGE	8	16
40104	40105	AI VOLTAGE SPAN	1	16
40105	40106	AI VOLTAGE SPAN	2	16
40106	40107	AI VOLTAGE SPAN	3	16
40107	40108	AI VOLTAGE SPAN	4	16
40108	40109	AI VOLTAGE SPAN	5	16
40109	40110	AI VOLTAGE SPAN	6	16
40110	40111	AI VOLTAGE SPAN	7	16
40111	40112	AI VOLTAGE SPAN	8	16

Holding Registers (Read / Write)				
Address Protocol	PLC	Entity	I/O Channel	Bits
40112	40113	AI, AO ZERO CURRENT	1	16
40113	40114	AI, AO ZERO CURRENT	2	16
40114	40115	AI, AO ZERO CURRENT	3	16
40115	40116	AI, AO ZERO CURRENT	4	16
40116	40117	AI, AO ZERO CURRENT	5	16
40117	40118	AI, AO ZERO CURRENT	6	16
40118	40119	AI, AO ZERO CURRENT	7	16
40119	40120	AI, AO ZERO CURRENT	8	16
40120	40121	AI, AO CURRENT SPAN	1	16
40121	40122	AI, AO CURRENT SPAN	2	16
40122	40123	AI, AO CURRENT SPAN	3	16
40123	40124	AI, AO CURRENT SPAN	4	16
40124	40125	AI, AO CURRENT SPAN	5	16
40125	40126	AI, AO CURRENT SPAN	6	16
40126	40127	AI, AO CURRENT SPAN	7	16
40127	40128	AI, AO CURRENT SPAN	8	16
40128	40129	COMM CONNECTION	-	16
40129	40130	COMM TIMEOUT LATCH	-	16
40130	40131	COMM PORT BAUD RATE	-	16
40131	40132	COMM PORT PARITY	-	16
40132	40133	COM PORT STOP BITS	-	16
40133	40134	MODBUS MIN TRANSMIT INTER-MSG INTERVAL	-	16
40134	40135	RS485 TURN ON DELAY	-	16
40135	40136	RS485 TURN OFF DELAY	-	16

## 10.5. Modbus Timing

Communication from the Base Modules to Expansion Modules occurs on a bus architecture.

- The bus architecture provides the fastest communication times for the entire stack because all Expansion Modules see the message from the Base at the same time.
- There is no difference in messaging times or execution times whether there is one Expansion Module in a stack or fifteen.
- The Modbus command response time is the time it takes a device to interpret and respond to a Modbus command or query.

**Example:** Polling the value of a 4 to 20 mA input.

### 10.5.1. Modbus Command Response Time by Device and Command Type

The output execution delay time is the time it takes a device to execute a command (e.g., change a Digital Output from low to high).

The time is referenced from the moment the complete Modbus command arrives at the data port.

Modbus Command Response Time by Device and Command Type					
	Serial Base	Expansion Module	Expansion Module	Expansion Module	
Stack ID	0	1	2	15	Units
<b>Command 1: Read Coils</b>					
1 coil	4	11	11	11	ms
160 coils	6	14	14	14	ms
<b>Command 2: Read Discrete Inputs</b>					
1 discrete input	4	11	11	11	ms
80 discrete inputs	6	12	12	12	ms
<b>Command 3: Read Holding Registers</b>					
1 holding register	4	11	11	11	ms
125 holding registers	18	52	52	52	ms
<b>Command 4: Read Input Registers</b>					
1 input register	4	11	11	11	ms
125 input registers	18	52	52	52	ms

Modbus Command Response Time by Device and Command Type					
	Serial Base	Expansion Module	Expansion Module	Expansion Module	
Stack ID	0	1	2	15	Units
<b>Command 5: Write Single Coil</b>	4	11	11	11	ms
<b>Command 6: Write Single Register</b>	4	11	11	11	ms
<b>Command 15: Write Multiple Coils</b>					
2 coils	4	11	11	11	ms
120 coils	6	14	14	14	ms
<b>Command 16: Write Multiple Registers</b>					
2 holding registers	4	11	11	11	ms
123 holding registers	11	43	43	43	ms

### 10.5.2. Modbus Output Execution Delay Time by Device and I/O Type

Modbus Output Execution Delay Time by Device and I/O Type					
	Serial Base	Expansion Module	Expansion Module	Expansion Module	
Stack ID	0	1	2	15	Units
<b>Non-Isolated Digital Output</b>					
Command 5 (writing 1 coil)	3	6	6	6	ms
Command 15 (writing 120 coils)	3	8	8	8	ms
<b>Isolated Digital Output</b>					
Command 5 (writing 1 coil)	17	14	14	14	ms
Command 15 (writing 120 coils)	18	16	16	16	ms
<b>Analog Output</b>					
Command 6 (writing 1 registers)	3	6	6	6	ms
Command 16 (writing 123 registers)	3	33	33	33	ms

## 11. Modbus Register Descriptions

---

This section describes the functionality of each register in detail.

- The register addresses are referenced in protocol addressing (Base 0).
- For PLC addressing (Base 1), add 1 to each register address listed.

When using the Modbus register:

- Add 200 to the register addresses for each device in the stack to access stacked Expansion Modules.

**Example:** To set register 10004 in your 2nd expansion module, the address is 10404.

- Add 1 to registers in protocol addressing (Base 0) to obtain PLC addressing (Base 1).

**Important!:** Modbus register readings are accurate 10 seconds after powering on the device.

- [Holding Coils \(Read / Write\) Descriptions \(on page 80\)](#)
- [Discrete Inputs \(Read-Only\) Descriptions \(on page 83\)](#)
- [Input Registers \(Read-Only\) Descriptions \(on page 83\)](#)
- [Holding Registers \(Read / Write\) Descriptions \(on page 85\)](#)

## 11.1. Holding Coils (Read / Write) Descriptions

### 11.1.1. 0 to 11: DO, Sensor Power ON

Upon power up, this register takes the state of **Default DO, Sensor Power State** if the **Apply Default DO, AO, Sensor Power** register is set to **(1) ON**.

0 to 11: DO, Sensor Power ON	
Channel	Description
Universal Channel as Digital Output	<ul style="list-style-type: none"> <li>When a universal channel is configured as Digital Output and this coil is set to <b>(1) ON</b>, the transistor turns on and sinks current to ground.</li> <li>When this coil is set to <b>(0) OFF</b>, the transistor turns off and the output remains floating, unless the internal pull-up or pull-down resistor is enabled.</li> <li>For more information about the Resistor Pull setting, see the register description <a href="#">Holding Registers (Read / Write) Descriptions (on page 85)</a>.</li> </ul>
Universal Channel as Sensor Power	<ul style="list-style-type: none"> <li>When a universal channel is configured as Sensor Power and this coil is set to <b>(1) ON</b>, then VBATT is applied to this channel through protection circuitry.</li> <li>When this coil is set to <b>(0) OFF</b>, then no power is applied to the channel.</li> <li>If Sensor Power should be applied on power up, then registers <b>24 to 35: Apply Default DO, AO, Sensor Power</b> and <b>48 to 59: Default DO, Sensor Power State</b> must be set to <b>ON (1)</b> for the appropriate channel.</li> </ul>
Isolated Channel as Digital Output	<ul style="list-style-type: none"> <li>When an isolated channel is configured as Digital Output and this coil is set to <b>(1) ON</b>, the relay closes and the terminals are shorted together.</li> <li>When this coil is set to <b>(0) OFF</b>, the relay opens and the terminals for the channel are left floating.</li> </ul>

### 11.1.2. 24 to 35: Apply Default DO, AO, Sensor Power

This register is used upon device power up and upon communication timeout.

- If this register is set to **(1) ON**, upon power up, channels configured as Digital Output, Analog Output, and Sensor Power output their default values.
- If this register is set to **(0) OFF**, then factory default values are applied upon power up.

Every device has a timer that is reset when it receives a Modbus command or query.

- If the device does not receive a Modbus command or query for the time set in the **Default Delay** parameter in the **Stack Settings** tab in **Tool Suite**, then a communication timeout occurs.

- If a communication timeout occurs and this register is set to **(1) ON**, the channels configured as Digital Output, Analog Output, or Sensor Power changes outputs to the default settings.
- If this register is set to **(0) OFF**, then the channel outputs do not change.

### 11.1.3. 48 to 59: Default DO, Sensor Power State

The default state for channels configured as Digital Output and Sensor Power.

**Note:** For this setting to apply, register **24 to 35: Apply Default DO, AO, Sensor Power** register must be set to **(1) ON** for the channel.

### 11.1.4. 64 to 71: Clear Counter on Read

This register determines whether the Digital Input Counter is reset to zero (0) when read.

- Writing zero **(0)** in this register means the counts will accrue.
  - They will NOT erase automatically.
- Writing **1** to this register, will cause the register to reset to zero (0) after every read.

**Note:** See [Quick Reference Modbus Register Map \(on page 65\)](#) for specific offset information.

### 11.1.5. 72 to 83: DI Counter Clear

This register clears the Digital Input counters in one of two ways:

- Writing 1 to this register forces the counter to 0.
  - This method forces the count to 0 even if pulses have arrived since the last counter read.
- Writing 0 clears the register in a way called **Critical Counting**.
  - **Critical Counting** is a function that keeps track of all the pulses that have been reported.
- By clearing this register with **Critical Counting**, then the counter is set to the number of pulses that have arrived since the last counter read.



Use this to keep track of each pulse that arrives.

### 11.1.6. 92 to 95: High-Speed DI Counter on Isolated

There are four high-speed Digital Input counters available that support counting up to 10 kHz.

- Use this register to select which channel to use as high-speed counters.
- If a channel is NOT assigned to high-speed counting it supports standard speed counting.
- Standard-speed counters support 100 Hz pulses or 10 Hz pulses with de-bounce.

92 to 95: High-Speed DI Counter on Isolated		
Coil	Set to (1) ON	Set to (0) OFF
Coil 92	Channel 9 to high-speed Channel 5 to standard speed	Channel 9 to standard-speed Channel 5 to high-speed
Coil 93	Channel 10 to high-speed Channel 6 to standard speed	Channel 10 to standard-speed Channel 6 to high-speed
Coil 94	Channel 11 to high-speed Channel 7 to standard speed	Channel 11 to standard-speed Channel 7 to high-speed
Coil 95	Channel 12 to high-speed Channel 8 to standard speed	Channel 12 to standard-speed Channel 8 to high-speed

### 11.1.7. 96 to 106: DI Counter Falling Edge Increment

- When this coil is **(1) ON**, the counter for a Digital Input is incremented when the input goes from 1 to 0 (a falling edge).
- When this coil is **(0) OFF**, the counter for a Digital Input is incremented when the input goes from 0 to 1 (on a rising edge).

### 11.1.8. 112 to 119: AI Signed Integer Result

- When a channel is configured as Analog Input and this coil is **(1) ON**, the **AI Integer Result** register is a signed number.
  - A signed number is necessary to report negative input voltages or if the RTU/PLC supports signed results only.
- When this register is set to **(0) OFF**, the **AI Integer Result** register is an unsigned number.
  - The default is **(0) OFF**.

### 11.1.9. 120 to 127: AI, AO Current, Voltage Mode

- When set to **(1) ON**, an internal 250 ohm sense resistor is turned on to report 4 to 20 mA inputs.
  - The complete current range is from 0 to 25 mA.
- Setting this coil to **(0) OFF** disables the sense resistor and supports reading voltage input.
  - This is needed for 1 to 5 V and 0 to 10 V transmitters.
  - The complete voltage range is from -2.5 to +12.5 V.

### 11.1.10. 136 to 147: DI Counter Latch

This register is set to ON internally when the **DI Counter** register is incremented.

- This is useful for systems that poll the Digital Input states at slower speeds than the duration of Digital Input signals.
- Write **0** to this register to clear the latch.

### 11.1.11. 152 to 163: Pulse Counter De-Bounce

- If set to **(1) ON**, the software takes multiple samples before deciding that an edge is a real edge not noise.
  - The price is drastic reduction in max frequency that can be counted from 800 Hz to 10 Hz.
- If set to **(0) OFF**, there is no software processing and noise can be treated as signal (false counts may be encountered).

## 11.2. Discrete Inputs (Read-Only) Descriptions

### 11.2.1. 10000 to 10011: DI State

This input reports the present state of the channel configured as Digital Input.

### 11.2.2. 10024 to 10035: Circuitry Protection Active

- This input reports the status of circuitry protection on the channel.
  - Circuitry protection is used in Digital Output, Analog Input in current mode, and Sensor Power modes.
  - When this coil is **(1) ON**, an overload condition has been detected and the channel function is disabled for a short time.
  - The channel is retried at 10 second intervals to test whether the overload condition has been removed.
  - When the channel is within its limits, this register is **(0) OFF**.

## 11.3. Input Registers (Read-Only) Descriptions

### 11.3.1. 30000 to 30016: AI Integer Result

This register contains the most recent Analog Input conversion result reported as an integer.

- The scale of the **AI Integer Result** depends on the settings in the **AI Voltage Span** and **AI AO Current Span** registers.
- The **Long Integer Word Order** setting on the Serial Base determines the position of the MSW and LSW in the **AI Integer Result** registers for all devices in the stack.
  - Regular word order places the MSW at the lower address and the LSW at the higher address (e.g., MSW = 30000, LSW = 30001).
  - Inverted word order places the LSW at the lower address and the MSW at the higher address (e.g., LSW = 30000, MSW = 30001).

- **Long Integer Word Order** helps connections with controllers that only accept one word order or another.

**Note:** When a Radio Base is used then the **Long Integer Word Order** is forced to regular.

- The **AI Integer Result Justification** setting on the Serial Base determines the position of the **AI Result Integer** inside the 32-bit registers.
  - Left justification places the most significant 16 bits of the AI Result in the MSW.
    - Left justification is commonly used to access only the most significant 16 bits.
    - With left justification only 1 register can be accessed and obtain a 16-bit integer.
    - With left justification you generally read 2 registers and obtain a 32-bit integer containing a 20-bit AI Result.
    - When a Radio Base is used, then the **AI Integer Result Justification** is forced to left.
  - Right justification places the least significant 16 bits of the **AI Result** in the Least Significant Word (LSW).
    - Right justification is commonly used to access the complete 20-bit result.

### 11.3.2. 30032 to 30047: AI Result, Floating Point

This register contains the most recent Analog Input conversion result reported as a floating point number.

**Note:** This setting allows controllers that require reverse register order to access 32-bit floating point registers without additional programming.

- The decimal number represents the actual voltage in V or current in mA.
- The setting in registers **121 to 128: AI Current Mode** determines whether the channel is used in current or voltage mode.
- The **Floating Point Word Order** setting on the Serial Base determines the position of the MSW and LSW in the AI Result, Floating Point registers for all devices in the stack.
- Regular word order places the MSW at the lower address and the LSW at the higher address (e.g., MSW = 30000, LSW = 30001).
- Inverted word order places the LSW at the lower address and the MSW at the higher address (e.g., LSW = 30000, MSW = 30001).
- When a Radio Base is used then the **Long Integer Word Order** is forced to regular.

### 11.3.3. 30064 to 30087: DI Counter

The **DI Counter** reports the number of pulse edges seen on a Digital Input.

- The pulse edge (rising edge or falling edge) that increments the **DI Counter** is set by coils **96 to 107: DI Counter Falling Edge Increment**.
- Read both the MSW and LSW for a 32-bit unsigned integer.
- Alternatively, read the LSW to gain access to a 16-bit unsigned integer result.

- The maximum counting rate for:
  - de-bounced counters is 10 Hz with a minimum pulse width of 40 ms.
  - standard-speed counters is 100 Hz with a minimum pulse width of 4 ms.
  - high-speed counters is 10 kHz with a minimum pulse width of 40  $\mu$ s.
- Whether a channel is standard-speed or high-speed is determined by the setting of coils **92 to 95: High-speed DI Counter On Isolated**.
- The **Long Integer Word Order** setting on the Serial Base applies to these registers.

**Note:** See the [30000 to 30016: AI Integer Result \(on page 83\)](#) for a description of the Long Integer Word Order setting.

### 11.3.4. 30096: Modbus Request Counter

This register is a running total of Modbus requests.

- Every time a Modbus request is received and processed this register is incremented.
- This is useful for PLCs and RTUs that do not handle Modbus failures appropriately.
- If the PLC or RTU reports the same number in this register time after time despite continuous polling attempts, then communication has failed between the PLC and the I/O Expansion device.

### 11.3.5. 30112 to 30119: DO Current

This register represents the current in milliAmps flowing through Digital Output channels set to (1) ON.

**Important!** It is NOT meant to accurately measure the current to report an approximate current confirming flow.

### 11.3.6. 30152: Device Temperature

This is the temperature of the device circuit board reported as a signed integer with units of 1° C per Least Significant Bit (lsb).

### 11.3.7. 30153: VBATT

- This is the supply voltage to the device as an unsigned integer reported in 1 mV per LSb.
- This is useful to remotely monitor the battery level.

## 11.4. Holding Registers (Read / Write) Descriptions

### 11.4.1. 40000 to 40003: AO Command

This is the analog value to output when a channel is used as Analog Output.

- When registers **40072 to 40075: AO Resolution** are set to **0** then the scaling factor is 1  $\mu$ A per bit.
- When registers **40072 to 40075: AO Resolution** are NOT set to **0**, then the scaling factor is determined by registers **40120 to 40127: AI, AO Current Span**.

In both cases case, the value in the **40112 to 40119: AI, AO Zero Current** register is added to the **AO Command** register and the sum is the actual current output.

However, the output cannot be higher than 22 mA. If the sum of the **AI, AO Zero Current** register and the **AO Command** register is greater than 22 mA, the value of the **AO Command** is capped to reach the maximum output of 22 mA.

#### 11.4.2. 40008 to 40011: Default AO Command

The value in this register is the AO Command in default conditions.

#### 11.4.3. 40016 to 40027: Channel Mode

This register sets the channel to be one of these types:

- 0 - Off
- 1 - Digital Output
- 2 - Digital Input
- 3 - Analog Output
- 4 - Analog Input
- 5 - Sensor Power

**Important!** If a channel is changed to a different function, (e.g., change a Universal Channel from Digital Input to Analog Input) wait 2 seconds for reliable readings from the channel.

#### 11.4.4. 40040 to 40047: AI Filter Setting

The filter setting turns on filtering (a moving average) for **AI Integer Result** and **AI Floating Point Result**.

- Use filtering to reduce signal noise by providing a stable reading.
- Setting this register to 0 disables filtering.
- Setting this register to values from 1 to 5 increases the filtering / averaging times:
  - 1 - 10 seconds (0.1 Hz)
  - 2 - 25 seconds (0.04 Hz)
  - 3 - 50 seconds (0.02 Hz)
  - 4 - 100 seconds (0.01 Hz)
  - 5 - 250 seconds (0.004 Hz)

#### 11.4.5. 40056 to 40063: Resistor Pull Setting

- Setting this coil to:
  - 0 disables both resistors.

- 1 connects a 10 k $\Omega$  pull-down resistor to ground for use with closed-contact-to-voltage inputs and outputs.
- 2 connects a 1 k $\Omega$  pull-up resistor to 3 V for closed-contact-to-ground inputs and outputs.

#### 11.4.6. 40072 to 40075: AO Resolution

Use these registers to change the scaling of **AO Command**.

- Some PLCs and RTUs support only 16 bits, 14 bits, 12 bits, or signed integers.
- The **AO Command** scaling depends on this setting:
  - 0 - 1  $\mu$ A per bit
  - 16-bit resolution
  - 15-bit resolution (This is the recommended setting for PLCs or RTUs that only support 16-bit signed integers.)
  - 14-bit resolution
  - 12-bit resolution

#### 11.4.7. 40080 to 40091: DO Monostable Timeout

Enter the amount of time in milliseconds from 1 to 60000 (1 minute) after which the Digital Output goes to its default state as defined in register **48 to 59: Default DO, Sensor Power State**.

- When this register is set to a number **other than 0**, the mono-stable setting is enabled.
- When this register is set to **0**, the Digital Output is bi-stable and the monostable time out is no longer enabled.
- A bi-stable Digital Output maintains the last state until a command is received that changes the Digital Output state.

#### 11.4.8. 40096 to 40103: AI Zero Voltage

This register is the voltage that results in the Analog Input reporting 0 in the **AI Integer Result** register.

- The scaling factor for this register is 1 mV per bit and the valid range is from 0 to 10000 mV.
- It is useful for:
  - translating offset sensors (e.g., 1 to 5 V transmitters) so that their minimum output reports 0 in the **AI Integer Result** register.
  - adjusting AI readings to provide calibration capabilities.

**Note:** See **40104 to 40111: AI Voltage Span** for recommended settings with 1 to 5 V and 0 to 10 V sensors.

### 11.4.9. 40104 to 40111: AI Voltage Span

This register sets the span and scaling factor for **AI Integer Result**.

- This register added to **AI Zero Voltage** is the voltage that results in full scale in **AI Integer Result**.
- For 16-bit readings, full scale is 65535, and for 20-bit readings full scale is 1,048,575.

The scaling factor for this register is 1 mV per bit and the valid range is from 0 to 12,500 mV. It is useful for translating sensors such as 1 to 5 V transmitters so their maximum output reports full scale in the AI Integer Result register.

Recommended settings for 1 to 5 V sensors:

- Set **AI Zero Voltage** to 1000 (equal to 1 V).
- Set **AI Voltage Span** is 4000 (equal to 4 V = 5 V – 1V).
- When reading the full 20-bit result, the scaling factor is 3.8147 mV per LSB.
- When reading only the most significant 16 bits, the scaling factor is 61.035 mV per LSB.

Recommended settings for 0 to 10 V sensors:

- Set **AI Zero Voltage** to 0 (equal to 0 V).
- Set **AI Voltage Span** to 10000 (equal to 10 V).
- When reading the full 20-bit result in **AI Integer Result**, the scaling factor is 3.8147 mV per LSB.
- When reading only the most significant 16 bits in **AI Integer Result**, the scaling factor is 61.035 mV per LSB.

For other input ranges or for fine tuning the inputs:

- Set **AI Zero Voltage** to the minimum input voltage.
- Set **AI Voltage Span** to the input span = maximum input voltage - minimum input voltage.
- When reading the full 20-bit result, the scaling factor is **AI Voltage Span** / 1048576.
- When reading only the most significant 16 bits, the scaling factor is **AI Voltage Span** / 65536.
- For backwards compatibility, a setting of 0 forces the **AI Voltage Span** to 10000 mV.

### 11.4.10. 40112 to 40119: AI, AO Zero Current

When the channel is used as an Analog Input, this register is the current that results in the Analog Input reporting 0 in the **AI Integer Result** register.

- The scaling factor for this register is 1  $\mu$ A per bit and the valid range is from 0 to 25000  $\mu$ A.
- This register is useful for:
  - translating offset sensors such as 4 to 20 mA transmitters so that their minimum output reports 0 in the **AI Integer Result** register.
  - adjusting Analog Input readings to provide calibration capabilities.

When the channel is used as an Analog Output this register is the current that is output when the **AO Command** register is set to 0.

- The scaling factor for this register is 1  $\mu\text{A}$  per bit and the valid range is from 0 to 25000  $\mu\text{A}$ .
- This register is useful for outputting 4 to 20 mA signals so that their minimum output is 4 mA when the **AO Command** register is 0.

**Note:** See the description for [40120 to 40127: AI, AO Current Span \(on page 89\)](#) for recommended settings with 4 to 20 mA sensors.

#### 11.4.11. 40120 to 40127: AI, AO Current Span

The scaling factor for this register is 1  $\mu\text{A}$  per bit and the valid range is from 0 to 25,000  $\mu\text{A}$ .

- This register is useful for translating sensors such as 4 to 20 mA transmitters so that their maximum output reports full scale in the **AI Integer Result** register.
- For 16-bit readings full scale is 65535, and for 20-bit readings full scale is 1,048,575.

When the channel is used as an Analog Input this register sets the span and scaling factor for the **AI Integer Result** register. This register added to **AI, AO Zero Current** is the input current that results in full scale in the **AI Integer Result** register.

Recommended settings for 4 to 20 mA sensor inputs:

- Set **AI Zero Voltage** to 4000 (equal to 4 mA).
- Set **AI Voltage Span** to 16000 (equal to 16 mA = 20 mA – 4 mA).
- When reading the full 20-bit result in **AI Integer Result**, the scaling factor is 15.259 nA per LSB.
- When reading only the most significant 16 bits in **AI Integer Result**, the scaling factor is 244.14 nA per LSB.

For all other input ranges or for fine tuning the inputs:

- Set **AI Zero Voltage** to the minimum input voltage.
- Set **AI Voltage Span** to the output span = maximum input current - minimum input voltage.
- When reading the full 20-bit result in **AI Integer Result**, the scaling factor is **AI Voltage Span** / 1048576.
- When reading only the most significant 16 bits in **AI Integer Result**, the scaling factor is **AI Voltage Span** / 65536.

When the channel is used as an Analog Output this register sets the span and scaling factor for the **AO Command** register. This register added to **AI, AO Zero Current** is the output current when full scale is entered into **AO Command**.

Recommended settings for 4 to 20 mA outputs:

- Set **AI, AO Zero Voltage** to 4000 (equal to 4 mA).
- Set **AI, AO Voltage Span** is 16000 (equal to 16 mA = 20 mA – 4 mA).
- When writing all 12 bits in **AO Command**, the scaling factor is 15.259 nA per LSB.
- When writing all 14 bits in **AO Command**, the scaling factor is 61.035 nA per LSB.
- When writing all 15 bits in **AO Command**, the scaling factor is 122.07 nA per LSB.
- When writing all 16 bits in **AO Command**, the scaling factor is 244.14 nA per LSB.

For all other output ranges or for fine-tuning the inputs:

- Set **AI, AO Zero Voltage** to the minimum output current.
- Set **AI, AO Voltage Span** to the output span = maximum input current - minimum input voltage.
- When writing all 12 bits in **AO Command**, the scaling factor is **AI Voltage Span** / 4096.
- When writing all 14 bits in **AO Command**, the scaling factor is **AI Voltage Span** / 16384.
- When writing all 15 bits in **AO Command**, the scaling factor is **AI Voltage Span** / 32768.
- When writing all 16 bits in **AO Command**, the scaling factor is **AI Voltage Span** / 65536.

For backwards compatibility, a setting of 0 forces the **AI, AO Current Span** to 20000  $\mu$ A..

#### 11.4.12. 40128: Comm Connection

This is the serial port connector type of a Serial Base:

- RS-232 (0)
- RS-422 (1)
- RS-485 (2)

#### 11.4.13. 40129: Comm Timeout Latch

In case of communication failure, channels configured as Digital Output, Analog Output, and Sensor Power can be set up to go to default states.

- This register serves to inform (after communication is restored) that the communication timeout occurred long enough to activate the defaults.
- This register remains at **(1) ON** until set to **(0) OFF** by Modbus command.
- Setting to **0** clears the latch.

#### 11.4.14. 40130: Comm Port Baud Rate

The baud rate of the serial port.

The default setting is (0) 19200.

The options are:

- |             |             |              |               |
|-------------|-------------|--------------|---------------|
| • (0) 19200 | • (5) 2400  | • (9) 19200  | • (13) 76800  |
| • (1) 150   | • (6) 4800  | • (10) 28800 | • (14) 115200 |
| • (2) 300   | • (7) 9600  | • (11) 38400 | • (15) 153600 |
| • (3) 600   | • (8) 14400 | • (12) 57600 | • (16) 230400 |
| • (4) 1200  |             |              |               |

#### 11.4.15. 40131: Comm Port Parity

The parity of the port connected to the device.

The options are:

- (0) None
- (1) Even
- (2) Odd

#### 11.4.16. 40132: Comm Port Stop Bits

There currently is only one selection for Com Port Parity: **(1) Even**.

#### 11.4.17. 40133: Modbus Min Transmit Inter-Message Interval

The interval cannot be shorter than 2 ms; regardless of a setting in this register, the interval is automatically adjusted to be shorter than 3.5 character lengths.

- On the receive side, the interval between messages must be at least 2 ms.
- If the interval is less than 0.4 ms, received characters will be processed as one message.
- If the interval is between 0.4 and 2 ms, the Modbus message processing will not be reliable.

#### 11.4.18. 40134: RS-485 Turn-On Delay

If the **Comm Connection** register is set to (2) RS-485, set the number of milliseconds (ms) between the RS-485 transmitter turning on and the character transmission start.

- Set the delay between 0 and 10 ms.
- The default setting is 1 ms.

#### 11.4.19. 40135: RS-485 Turn-Off Delay

If the **Comm Connection** register is set to (2) RS-485, set the number of milliseconds (ms) between the RS-485 character transmission end and the transmitter turning off.

- Set the delay between 0 and 10 ms.
- The default setting is 1 ms.

---

## 12. Release Notes

---

These sections describe the additions, changes, known limitations, and workarounds in each software version. The most recent version is listed first.

### Version 2.2.0

**Release Date: January 2012**

#### **Additions and Changes**

- The 40000 to 40003: AO Command register cannot exceed the max output current of 22 mA. If the AO Command register is set so the value of that register and the 40112 to 40119: AI, AO Zero Current register together are more than 22 mA, the AO Command current is capped so the total current does not exceed 22 mA.
- Corrected power LED blinking issue.
- Corrected reporting of a signed analog input value.
- Fixed a pulse counter bug.

#### **Known Limitations and Workarounds**

- Channels 11 and 12 in the IOE-4440 and IOEX-4440 models do not function as high-speed counters.

### Version 2.1.0


**Release Date: August 2011**

#### **Additions and Changes**


- Added support for 153.6 and 230.4 kbaud data rates. Removed 110 kbaud support.
- Increased max pulse counting frequency to 800 Hz with 60/40 duty cycle.

- Added software pulse counter de-bouncing. With de-bouncing, the maximum counting frequency is 10 Hz; without de-bouncing the maximum counting frequency, as stated above.
- You can now set the pull-up resistor and pull-down resistors for a Digital Output using the same register and hardware as the Digital Input.
- Reduced max digital output current from 25 mA to 22 mA.

# 13. Expansion Module Dimensions

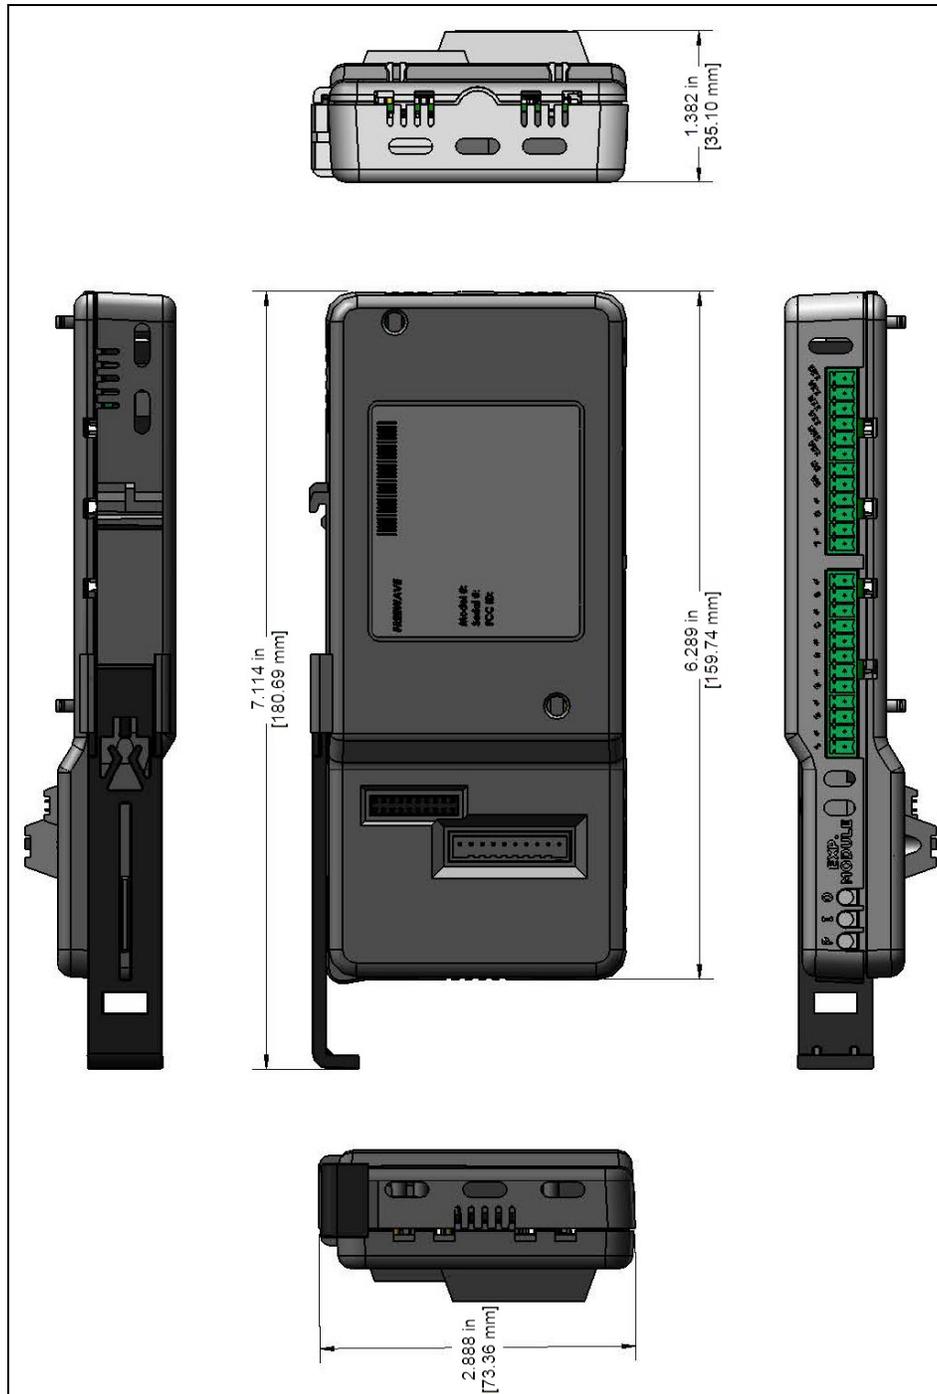

## 14. Serial Base Dimensions

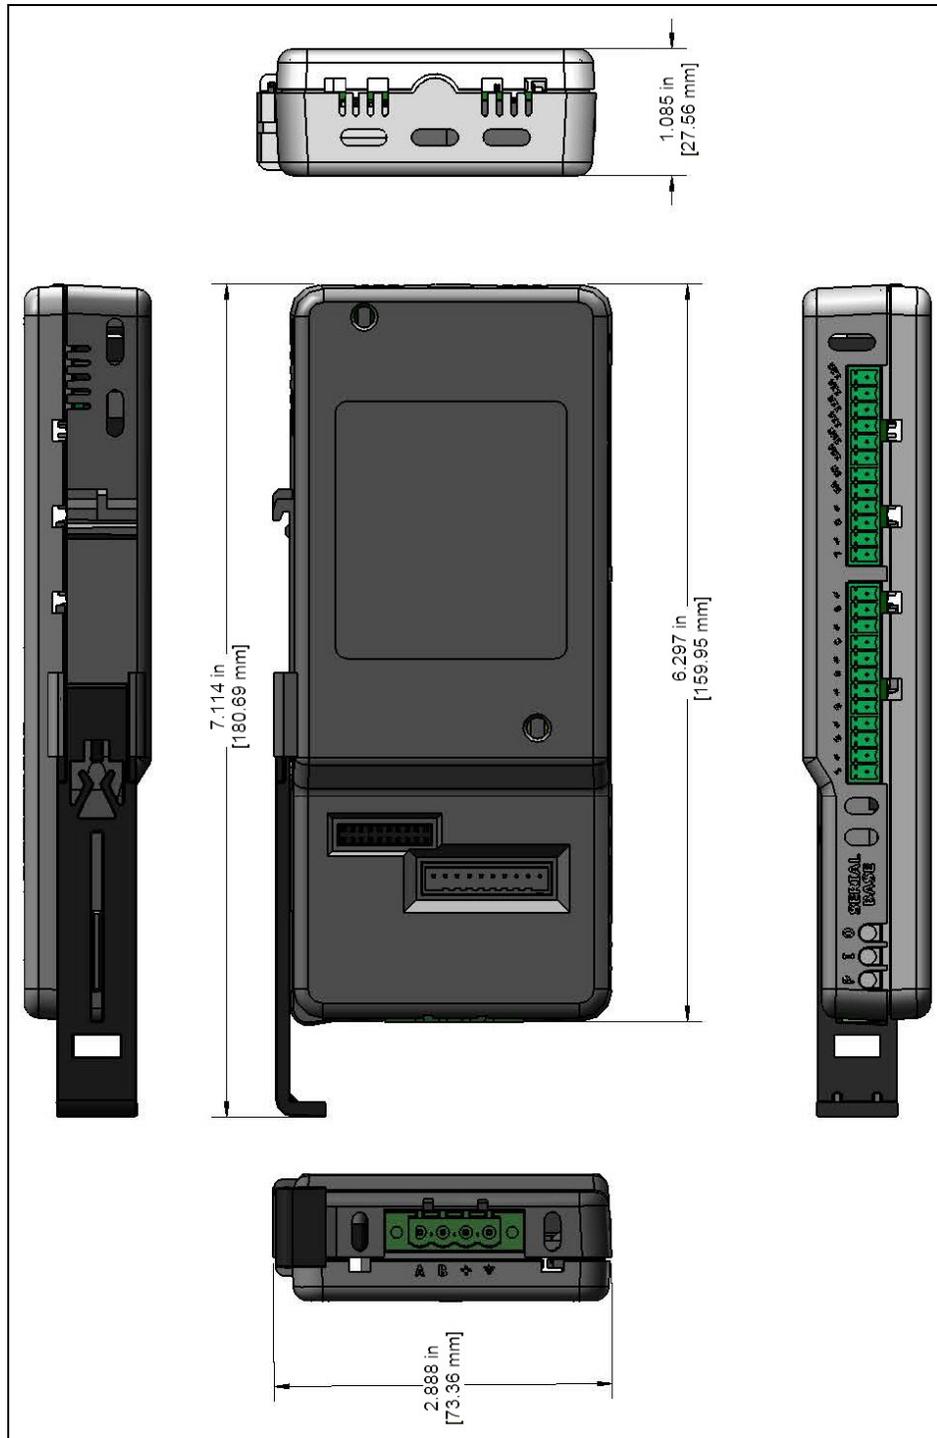

## Appendix A: Technical Specifications

---

### General Information

Technical Specifications	
Specification	Description
Operating Temperature	-40°C to +75°C -40°F to +167°F
Humidity	0 to 95% non-condensing
Dimensions	181.0 L x 79.4 W x 25.4 H (mm) 7.13 L x 3.13 W x 1.0 H (in.)
Weight	158.8 g (0.35 lbs.)
Mounting	Integrated 35 mm DIN rail clip

- [Digital Input \(on page 97\)](#)
- [Digital Output \(on page 97\)](#)
- [Analog Input \(on page 97\)](#)
- [Analog Output \(on page 97\)](#)
- [Sensor Power \(on page 98\)](#)
- [Part Number Summary \(on page 98\)](#)

## Digital Input

Digital Input			
	Universal Channels	Input-only Channels	Isolated Channels
Input ON voltage	> 3.0 V	> 3.0 V	> 3.2 V
Input OFF voltage	< 2.5 V	< 2.5 V	< 1.2 V
Pulse-counting frequency, standard	100 Hz or 4 ms	100 Hz or 4 ms	100 Hz or 4 ms
Pulse-counting frequency, high	-	10 kHz or 40 $\mu$ s	10 kHz or 40 $\mu$ s
Pull-up resistor	1 k $\Omega$ to 3 V	1 k $\Omega$ to 3 V	-
Pull-down resistor	10 k $\Omega$ to ground	10 k $\Omega$ to ground	-

## Digital Output

Digital Output			
	Universal Channels	Input-only Channels	Isolated Channels
Output ON current	1 A to ground	-	2 A
Output ON impedance	0.2 $\Omega$ to ground, plus diode	-	0.120 $\Omega$
Output OFF impedance	2.34 k $\Omega$ to ground	-	10 M $\Omega$
External voltage connection	V BAT	-	250 V

## Analog Input

Analog Input			
	Universal Channels	Input-only Channels	Isolated Channels
Resolution	20 bits	20 bits	-
Maximum Reading Error	0.10%	0.10%	-
Voltage Input Range	-2.5 to 12.5 V	-2.5 to 12.5 V	-
Current Input Range	0 to 22 mA	0 to 22 mA	-
Current Sense Resistor	250 $\Omega$	250 $\Omega$	-

## Analog Output

Analog Output			
	Universal Channels	Input-only Channels	Isolated Channels
Current Output Range	0 to 22 mA	-	-

<b>Analog Output</b>			
	<b>Universal Channels</b>	<b>Input-only Channels</b>	<b>Isolated Channels</b>
Maximum Output Error	0.25%	-	-

**Sensor Power**

<b>Sensor Power</b>			
	<b>Universal Channels</b>	<b>Input-only Channels</b>	<b>Isolated Channels</b>
Voltage Output	0.5 V below V BAT	-	-
Current Output	Up to 50 mA	-	-

**Part Number Summary**

<b>Serial Base Expansion Module</b>	<b>IOE-4440</b>	<b>IOE-4422</b>	<b>IOE-4404</b>
	<b>IOEX-4440</b>	<b>IOEX-4422</b>	<b>IOEX-4404</b>
Number of Universal Channels	4	4	4
Number of Input-Only Channels	4	4	4
Number of Isolated Digital Input Channels	4	2	0
Number of Isolated Digital Output Channels	0	2	4

## Appendix B: I/O Device LEDs

---

The LEDs on the Serial Base and Expansion Modules in a stack help identify the state of the system and the current action happening with each device in the stack:

- **Power** - Labeled with a P in enclosed Serial Bases and Expansion Modules, this is the LED closest to the edge of the device.
- **Inbound** - Labeled with an I in enclosed Serial Bases and Expansion Modules, this is the middle LED.
- **Outbound** - Labeled with an O in enclosed Serial Bases and Expansion Modules, this is the LED closest to the I/O channels.



**Warning!** If all the LEDs are Solid Red ■ or Blinking Red ◻, the device is receiving a firmware upgrade. Do NOT unplug the device or remove the device's power during a firmware upgrade. The device could become inoperable.

---

- [Expansion Module LEDs \(on page 100\)](#)
- [Serial Base LEDs \(on page 100\)](#)

## Expansion Module LEDs

Expansion Module LEDs			
LED State	Power (P)	Inbound (I)	Outbound (O)
Solid Green 	Power on	-	-
Intermittent Green Flash 	Low power mode	-	Sending information down the stack to the base
Blinking Green  *	Communication reset mode, device is gathering startup settings	-	-
Solid Red 	Firmware upgrade initiated*	<ol style="list-style-type: none"> <li>When the other LEDs are also solid red a firmware upgrade has been initiated</li> <li>Receiving a command from the base</li> </ol>	<ol style="list-style-type: none"> <li>When the other LEDs are also solid red a firmware upgrade has been initiated</li> <li>Receiving a command from the base</li> </ol>
Intermittent Red Flash 	-	Device is being polled	-
Blinking Red  *	Internal checks after firmware upgrade	Internal checks after firmware upgrade	Sending information to devices in the stack

**Note:** \*The Incoming and Outgoing LEDs may appear to blink depending on how many registers are read during a single polling cycle.

## Serial Base LEDs

Serial Base LEDs			
LED State	Power (P)	Inbound (I)	Outbound (O)
Solid Green 	Power on	-	-
Intermittent Green Flash 	Low power mode	Receiving a message from the rest of the stack	Device is sending data after being polled
Blinking Green  *	Communication reset mode, device is gathering startup settings	-	Device is sending data when polled
Solid Red 	Firmware upgrade initiated*	When the other LEDs are also solid red a firmware upgrade has been initiated.	When the other LEDs are also solid red a firmware upgrade has been initiated.
Intermittent Red Flash 	-	<ol style="list-style-type: none"> <li>If other LEDs are also intermittently flashing red, internal checks after firmware upgrade.</li> <li>Device is being polled.</li> </ol>	If other LEDs are also intermittently flashing red, internal checks after firmware upgrade.
Blinking Red  *	Internal checks after firmware upgrade	Internal checks after firmware upgrade	Sending information to devices in the stack

## Appendix C: FreeWave Legal Information

---

### Export Notification

FreeWave Technologies, Inc. products may be subject to control by the Export Administration Regulations (EAR) and/or the International Traffic in Arms Regulations (ITAR). Export, re-export, or transfer of these products without required authorization from the U.S. Department of Commerce, Bureau of Industry and Security, or the U.S. Department of State, Directorate of Defense Trade Controls, as applicable, is prohibited. Any party exporting, re-exporting, or transferring FreeWave products is responsible for obtaining all necessary U.S. government authorizations required to ensure compliance with these and other applicable U.S. laws. Consult with your legal counsel for further guidance.

### Restricted Rights

Any product names mentioned in this manual may be trademarks or registered trademarks of their respective companies and are hereby acknowledged.

This manual is only for use by purchasers and other authorized users of FreeWave products.

No part of this manual may be reproduced or transmitted in any form or by any means, electronic or mechanical, or for any purpose without the express written permission of FreeWave Technologies, Inc. FreeWave reserves the right to make changes to this manual without notice. FreeWave assumes no responsibility or liability for the use of this manual or the infringement of any copyright or other proprietary right.

FreeWave products are designed and manufactured in the United States of America.

### UL Notifications



Models IOE-4404, IOE-4422, IOE-4440, IOEX-4404, IOEX-4422, and IOEX-4440 are suitable for use in Class 1, Division 2, Groups A, B, C, and D or non-hazardous locations only.

The connectors shall not be connected or disconnected while circuit is live unless area is known to be non-hazardous.



**Warning!** Explosion Hazard - Substitution of any component may impair suitability for Class 1, Division 2.

---



**Warning!** Do not remove or insert the diagnostics cable while the circuit is live unless the area is known to be free of ignition concentrations or flammable gases and vapors.

---

Input voltage for the IOE and IOEX models is +7.5 to +30 VDC.

**Subject Devices are to be installed in the vertical orientation only. Devices were tested for vertical orientation only and not the horizontal orientation.**

**Important!** Input power and all I/O power, except relay output contacts, shall be derived from a single Class 2 power source, or equivalent.

#### **GNU License Notification**

Some of the software in the software is licensed under the GNU General Public License and other Open Source and Free Software licenses. You can obtain corresponding source by contacting FreeWave and requesting the source on CD.

**FREEWAVE**